



DECEMBER 2024

# MONTHLY CONSTRUCTION WATER QUALITY MONITORING REPORT

December 2024

Project No: 3200-0645

Project: Transgrid Maragle 500/330 kV Substation

Private & Confidential

# CONTENTS

1.	BACKGROUND .....	7
2.	INTRODUCTION .....	8
3.	METHODOLOGY.....	10
4.	BASELINE WATER QUALITY.....	16
4.1.	WATER QUALITY OBJECTIVES .....	16
4.2.	SITE SPECIFIC GUIDELINE VALUES.....	16
5.	DECEMBER 2024 MONITORING .....	17
5.1.	OBSERVATIONS.....	17
5.2.	RESULTS.....	22
5.2.1.	KEY PHYSICAL AND CHEMICAL PARAMETERS.....	22
	TEMPERATURE.....	23
	PH .....	24
	DISSOLVED OXYGEN .....	25
	SPECIFIC CONDUCTANCE .....	26
	ELECTRICAL CONDUCTIVITY .....	27
	TURBIDITY .....	28
	TOTAL SUSPENDED SOLIDS.....	29
	REDOX.....	30
	NITROGEN OXIDES .....	31
	AMMONIA .....	32
	CYANIDE.....	33
	TOTAL HARDNESS .....	34
	TOTAL KJELDAHL NITROGEN.....	35
	TOTAL NITROGEN .....	36
	TOTAL PHOSPHORUS .....	37
	REACTIVE PHOSPHORUS.....	38
5.2.2.	DISSOLVED METALS .....	39
5.2.3.	TOTAL METALS.....	40
5.3.	DISCUSSION .....	41
6.	CONCLUSION .....	43
	REFERENCES .....	44

## TABLES

TABLE 1 SWQ MONITORING LOCATIONS OUTLINED IN THE METHODOLOGY (NGH, 2022).....	10
TABLE 2 SEASONAL SSGV (NGH, 2024) AND DGV (ANZG, 2018) FOR WATER QUALITY PARAMETERS .....	13
TABLE 3 FIELD OBSERVATIONS DURING SAMPLING.....	17
TABLE 4: RESULTS FOR DISSOLVED METALS.....	39
TABLE 5: RESULTS FOR TOTAL METALS .....	40

## FIGURES

FIGURE 1 LOCALITY OF THE PROJECT AND SWQ MONITORING LOCATIONS .....	9
FIGURE 2 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE YR-RS AND TR-RS IN RELATION TO THE PROJECT .....	11
FIGURE 3 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE WC-RS IN RELATION TO THE PROJECT.....	12
FIGURE 4 : TEMPERATURE FOR YARRANGOBILLY RIVER CATCHMENT .....	23
FIGURE 5: TEMPERATURE FOR TALBINGO RESERVOIR .....	23
FIGURE 6: TEMPERATURE FOR YORKERS CREEK CATCHMENT .....	23
FIGURE 7: PH FOR YARRANGOBILLY RIVER CATCHMENT .....	24
FIGURE 8: PH FOR TALBINGO RESERVOIR .....	24
FIGURE 9: PH FOR YORKERS CREEK CATCHMENT .....	24
FIGURE 10: DO FOR YARRANGOBILLY RIVER CATCHMENT .....	25
FIGURE 11: DO FOR TALBINGO RESERVOIR.....	25
FIGURE 12: DO FOR YORKERS CREEK CATCHMENT .....	25
FIGURE 13: SPC FOR YARRANGOBILLY RIVER CATCHMENT .....	26
FIGURE 14: SPC FOR TALBINGO RESERVOIR.....	26
FIGURE 15: SPC FOR YORKERS CREEK CATCHMENT .....	26
FIGURE 16: EC FOR YARRANGOBILLY RIVER CATCHMENT .....	27
FIGURE 17: EC FOR TALBINGO RESERVOIR.....	27
FIGURE 18: EC FOR YORKERS CREEK CATCHMENT .....	27
FIGURE 19: TURBIDITY FOR YARRANGOBILLY RIVER CATCHMENT .....	28
FIGURE 20: TURBIDITY FOR TALBINGO RESERVOIR.....	28
FIGURE 21: TURBIDITY FOR YORKERS CREEK CATCHMENT .....	28
FIGURE 22: TSS FOR YARRANGOBILLY RIVER CATCHMENT .....	29
FIGURE 23: TSS FOR TALBINGO RESERVOIR .....	29
FIGURE 24: TSS FOR YORKERS CREEK CATCHMENT .....	29
FIGURE 25: REDOX FOR YARRANGOBILLY RIVER CATCHMENT .....	30
FIGURE 26: REDOX FOR TALBINGO RESERVOIR .....	30

FIGURE 27: REDOX FOR YORKERS CREEK CATCHMENT .....	30
FIGURE 28: NITROGEN OXIDES FOR YARRANGOBILLY RIVER CATCHMENT .....	31
FIGURE 29: NITROGEN OXIDES FOR TALBINGO RESERVOIR.....	31
FIGURE 30: NITROGEN OXIDES FOR YORKERS CREEK CATCHMENT .....	31
FIGURE 31: AMMONIA FOR YARRANGOBILLY RIVER CATCHMENT .....	32
FIGURE 32: AMMONIA FOR TALBINGO RESERVOIR .....	32
FIGURE 33: AMMONIA FOR YORKERS CREEK CATCHMENT .....	32
FIGURE 34: CYANIDE FOR YARRANGOBILLY RIVER CATCHMENT .....	33
FIGURE 35: CYANIDE FOR TALBINGO RESERVOIR .....	33
FIGURE 36: CYANIDE FOR YORKERS CREEK CATCHMENT.....	33
FIGURE 37: $\text{CaCO}_3$ FOR YARRANGOBILLY RIVER CATCHMENT .....	34
FIGURE 38: $\text{CaCO}_3$ FOR TALBINGO RESERVOIR .....	34
FIGURE 39: $\text{CaCO}_3$ FOR YORKERS CREEK CATCHMENT .....	34
FIGURE 40: TKN FOR YARRANGOBILLY RIVER CATCHMENT .....	35
FIGURE 41: TKN FOR TALBINGO RESERVOIR .....	35
FIGURE 42: TKN FOR YORKERS CREEK CATCHMENT .....	35
FIGURE 43: TN FOR YARRANGOBILLY RIVER CATCHMENT .....	36
FIGURE 44: TN FOR TALBINGO RESERVOIR .....	36
FIGURE 45: TN FOR YORKERS CREEK CATCHMENT .....	36
FIGURE 46: TP FOR YARRANGOBILLY RIVER CATCHMENT .....	37
FIGURE 47: TP FOR TALBINGO RESERVOIR.....	37
FIGURE 48: TP FOR YORKERS CREEK CATCHMENT .....	37
FIGURE 49: RP FOR YARRANGOBILLY RIVER CATCHMENT .....	38
FIGURE 50: RP FOR TALBINGO RESERVOIR .....	38
FIGURE 51: RP FOR YORKERS CREEK CATCHMENT .....	38

## APPENDICES

APPENDIX A: FIELD SHEET (UGL, 2024)

APPENDIX B: COA (ALS, 2024A), QA/QC ASSESSMENT (ALS, 2024B) AND QCR (ALS, 2024C)

APPENDIX C: DECEMBER 2024 SWQ MONITORING RESULTS

APPENDIX D: CALIBRATION CERTIFICATE

## ABBREVIATIONS

Acronym	Full Form
°C	degrees Celsius
µS/cm	micro Siemens per centimetre
%	percent
Ag	Silver
Al	Aluminium
ALS	ALS Limited
ANZECC	Australian and New Zealand Environment and Conservation Council
ANZG	Australian and New Zealand Guidelines
ARMCANZ	Agriculture and Resource Management Council of Australia and New Zealand
As	Arsenic
Baseline Report	'Baseline Water Quality Report' (NGH, 2024)
CaCO <sub>3</sub>	Total Hardness
Cd	Cadmium
COA	'Certificate of Analysis' (ALS, 2024a)
Cr	Chromium
Cu	Copper
DGV	Default Guideline Values
DO	Dissolved Oxygen
EC	Electrical Conductivity
EIS	Environmental Impact Statement
EPL	Environmental Protection Licence
Fe	Iron
Field Sheet	'Water Quality Monitoring Field Data Sheet' (UGL, 2024)
Hg	Mercury
km	kilometres
km/h	kilometres per hour
KNP	Kosciuszko National Park
kV	kilovolt
LOR	limit of reporting
mg/L	milligram per litre
mm	millimetre
Mn	Manganese
mV	millivolt
NATA	National Association of Testing Authorities, Australia
NEM	National Energy Market

## ABBREVIATIONS

Acronym	Full Form
NGH	NGH Pty Ltd
Ni	Nickel
NSW	New South Wales
NTU	Nephelometric Turbidity Unit
Pb	Lead
ppm	parts per million
Pty Ltd	Proprietary Limited
QA/QC Assessment	'QA/QC Compliance Assessment to assist with Quality Review' (ALS, 2024b)
QCR	'Quality Control Report' (ALS, 2024c)
RP	reactive phosphorus
RS	Reference Site
Snowy 2.0	Snowy Scheme expansion project (EPBC 2018/8322)
Snowy Hydro	Snowy Hydro Limited
Snowy Scheme	Snowy Mountains Hydro-electric Scheme
SPC	specific conductance
SSGV	Site Specific Guideline Values
SW	surface water
SWQ	surface water quality
TDS	Total Dissolved Solids
The Methodology	'Pre-construction Water Quality Monitoring Program and Methodology' (NGH, 2022)
The Project	Construction of a 330 kV substation and overhead transmission lines between Nurenmerenmong, NSW and Cabramurra, NSW
TKN	Total Kjeldahl Nitrogen
TN	Total Nitrogen
TP	Total Phosphorus
Transgrid	The Trustee for the NSW Electricity Operations Trust
TSS	Total Suspended Solids
UGL	UGL Limited
WQO	water quality objectives
Zn	Zinc

## 1. BACKGROUND

In 2020 Snowy Hydro Limited (Snowy Hydro) obtained approval (EPBC 2018/8322) to expand the existing Snowy Mountains Hydro-electric Scheme (Snowy Scheme), by linking the existing Tantangara and Talbingo reservoirs through a series of underground tunnels and constructing a new underground hydro-electric power station (Snowy 2.0).

To connect Snowy 2.0 to the National Energy Market (NEM), a new transmission connection was required. The Trustee for the New South Wales (NSW) Electricity Operations Trust (TransGrid) is constructing a 330 kilovolt (kV) substation and overhead transmission lines (the Project) to facilitate the connection of Snowy 2.0 to the existing electrical transmission network. The Project is located within Kosciuszko National Park (KNP) between Nurenmerenmong and Cabramurra, NSW, approximately 27 kilometres (km) east of Tumbarumba, NSW (Figure 1). UGL Limited (UGL) has been engaged on behalf of Transgrid to undertake the Project.

## 2. INTRODUCTION

The Project is adjacent to, and forms part of, the Snowy 2.0 project area and is located within KNP, an area of high conservation value. A total of 22 mapped waterways, tributaries of Yarrangobilly River and Tumut River, transect the Project Boundary (Figure 1).

One of the conditions of approval to meet the requirements outlined in the 'Environmental Impact Statement' (EIS) (Jacobs, 2020) and the Project's Environmental Protection Licence (EPL 21753) is to undertake regular surface water quality (SWQ) monitoring to mitigate environmental impacts on SWQ.

Pre-construction SWQ monitoring was undertaken by NGH Pty Ltd (NGH) between March 2022 and February 2024 to determine site specific baseline values for SWQ parameters prior to Project construction works. The pre-construction SWQ monitoring was undertaken using the 'Pre-construction Water Quality Monitoring Program and Methodology' (the Methodology) developed by NGH in 2022 (refer Section 3). Two years of pre-construction SWQ monitoring was analysed and summarised in the 'Baseline Water Quality Report' (Baseline Report) (NGH, 2024). The results were used to determine seasonal Site Specific Guideline Values (SSGV) for ongoing SWQ monitoring during the construction phase.

Construction for the Project commenced in March 2024. Construction SWQ monitoring will be undertaken by UGL on a monthly basis as per the revised methodology outlined in Section 3 to identify potential changes to SWQ that may be associated with the Project. SW samples from the construction SWQ monitoring would be analysed and presented in monthly Construction Water Quality Monitoring Reports.



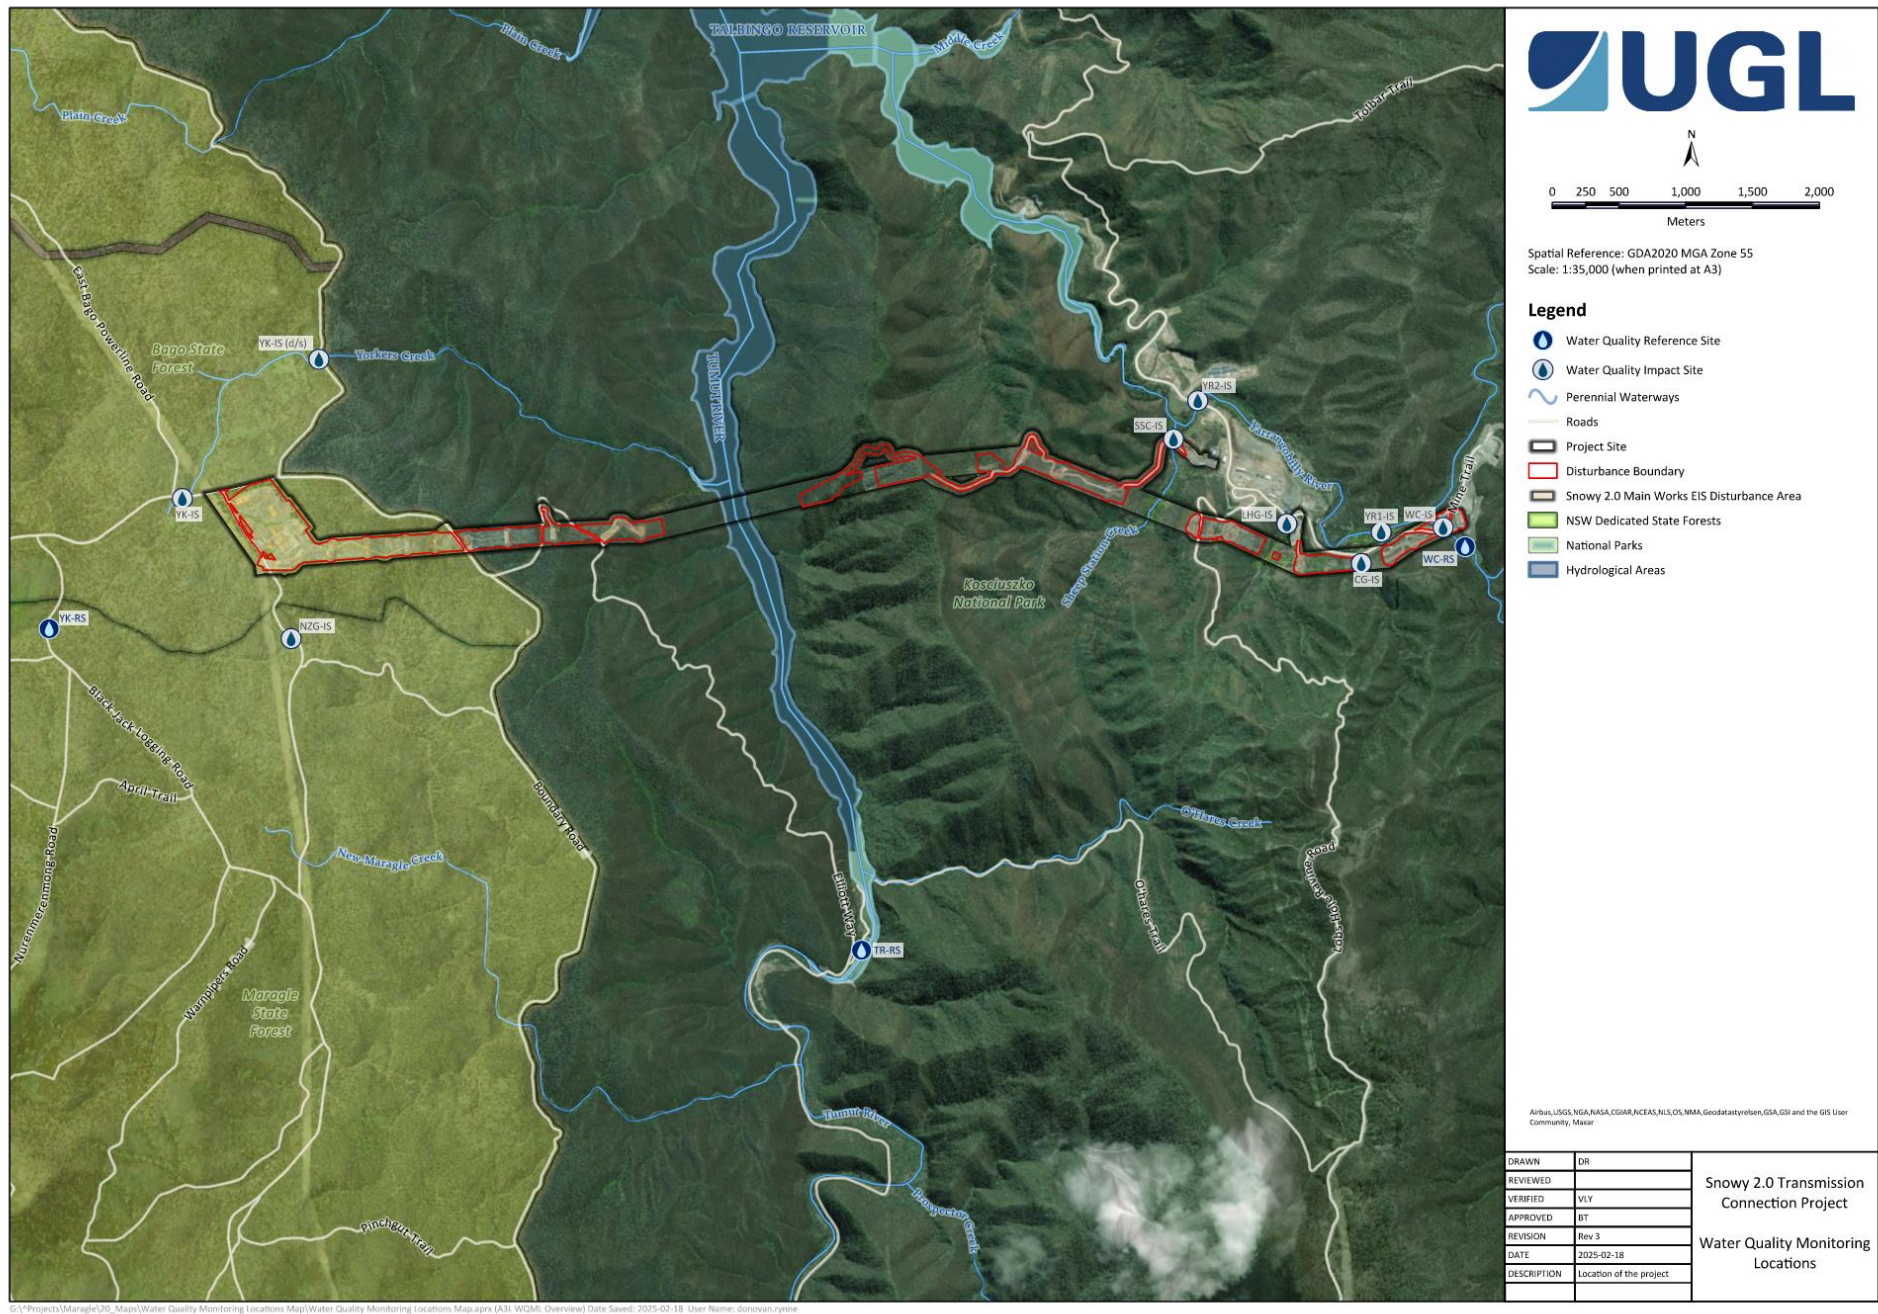


FIGURE 1 LOCALITY OF THE PROJECT AND SWQ MONITORING LOCATIONS

### 3. METHODOLOGY

The Methodology was prepared by NGH in 2022 to support the pre-construction SWQ monitoring for the Project. The Methodology detailed the water quality objectives (WQO) for the Project, identified the monitoring locations and outlined the methodology for surface water (SW) sampling during the pre-construction phase. The Methodology (NGH, 2022) took into account the Project location within an area of high conservation value where the WQO for physical and chemical stressors, as outlined in the 'Australian and New Zealand Guidelines for Fresh and Marine Water Quality' (ANZG) (ANZG, 2018), includes no change in biodiversity beyond natural variability and where possible, there should also be no change in water/sediment chemical and physical properties, including toxicants.

Monitoring locations are outlined in Table 1. Figure 2 and Figure 3 show the water quality monitoring locations in relation to the Project and Snowy 2.0.

The Methodology (NGH, 2022) has been revised for construction SWQ monitoring by taking into account the seasonal SSGV set out in the Baseline Report (NGH, 2024) (refer to Section 4.2).

Construction SWQ monitoring would be analysed against the seasonal SSGV where available and appropriate. The Default Guideline Values (DGV) for Upland Rivers (ANZG, 2018) would be applied to water quality parameters that were not assessed in the Baseline Report (NGH, 2024) or where a guideline range is more appropriate. Table 2 outlines the seasonal SSGV and DGV used to compare construction SWQ to pre-construction SWQ.

**Table 1 SWQ monitoring locations outlined in the Methodology (NGH, 2022)**

WATER QUALITY MONITORING LOCATIONS					
ID	Waterway	Site Type	Catchment	Latitude	Longitude
WC-RS	Wallace Creek	Reference	Yarrangobilly River	-35.794258	148.415253
WC-IS	Wallace Creek	Impact		-35.792982	148.413404
CG-IS	Cave Gully	Impact		-35.795495	148.406665
YR1-IS	Yarrangobilly River	Impact		-35.793358	148.408277
LHG-IS	Lick Hole Gully	Impact		-35.792890	148.400445
YR2-IS	Yarrangobilly River	Impact		-35.784656	148.392921
SSC-IS	Sheep Station Creek	Impact		-35.793243	148.391046
TR-RS	Talbingo Reservoir	Reference	Talbingo Reservoir	-35.822094	148.365690
YK-RS	Yorkers Creek	Reference	Yorkers Creek	-35.801126	148.297979
YK-IS (D/S)	Yorkers Creek	Impact		-35.782684	148.320040
NZG-IS	New Zealand Gully	Impact		-35.801575	148.318051
YK-IS	Yorkers Creek	Impact		-35.792209	148.308878



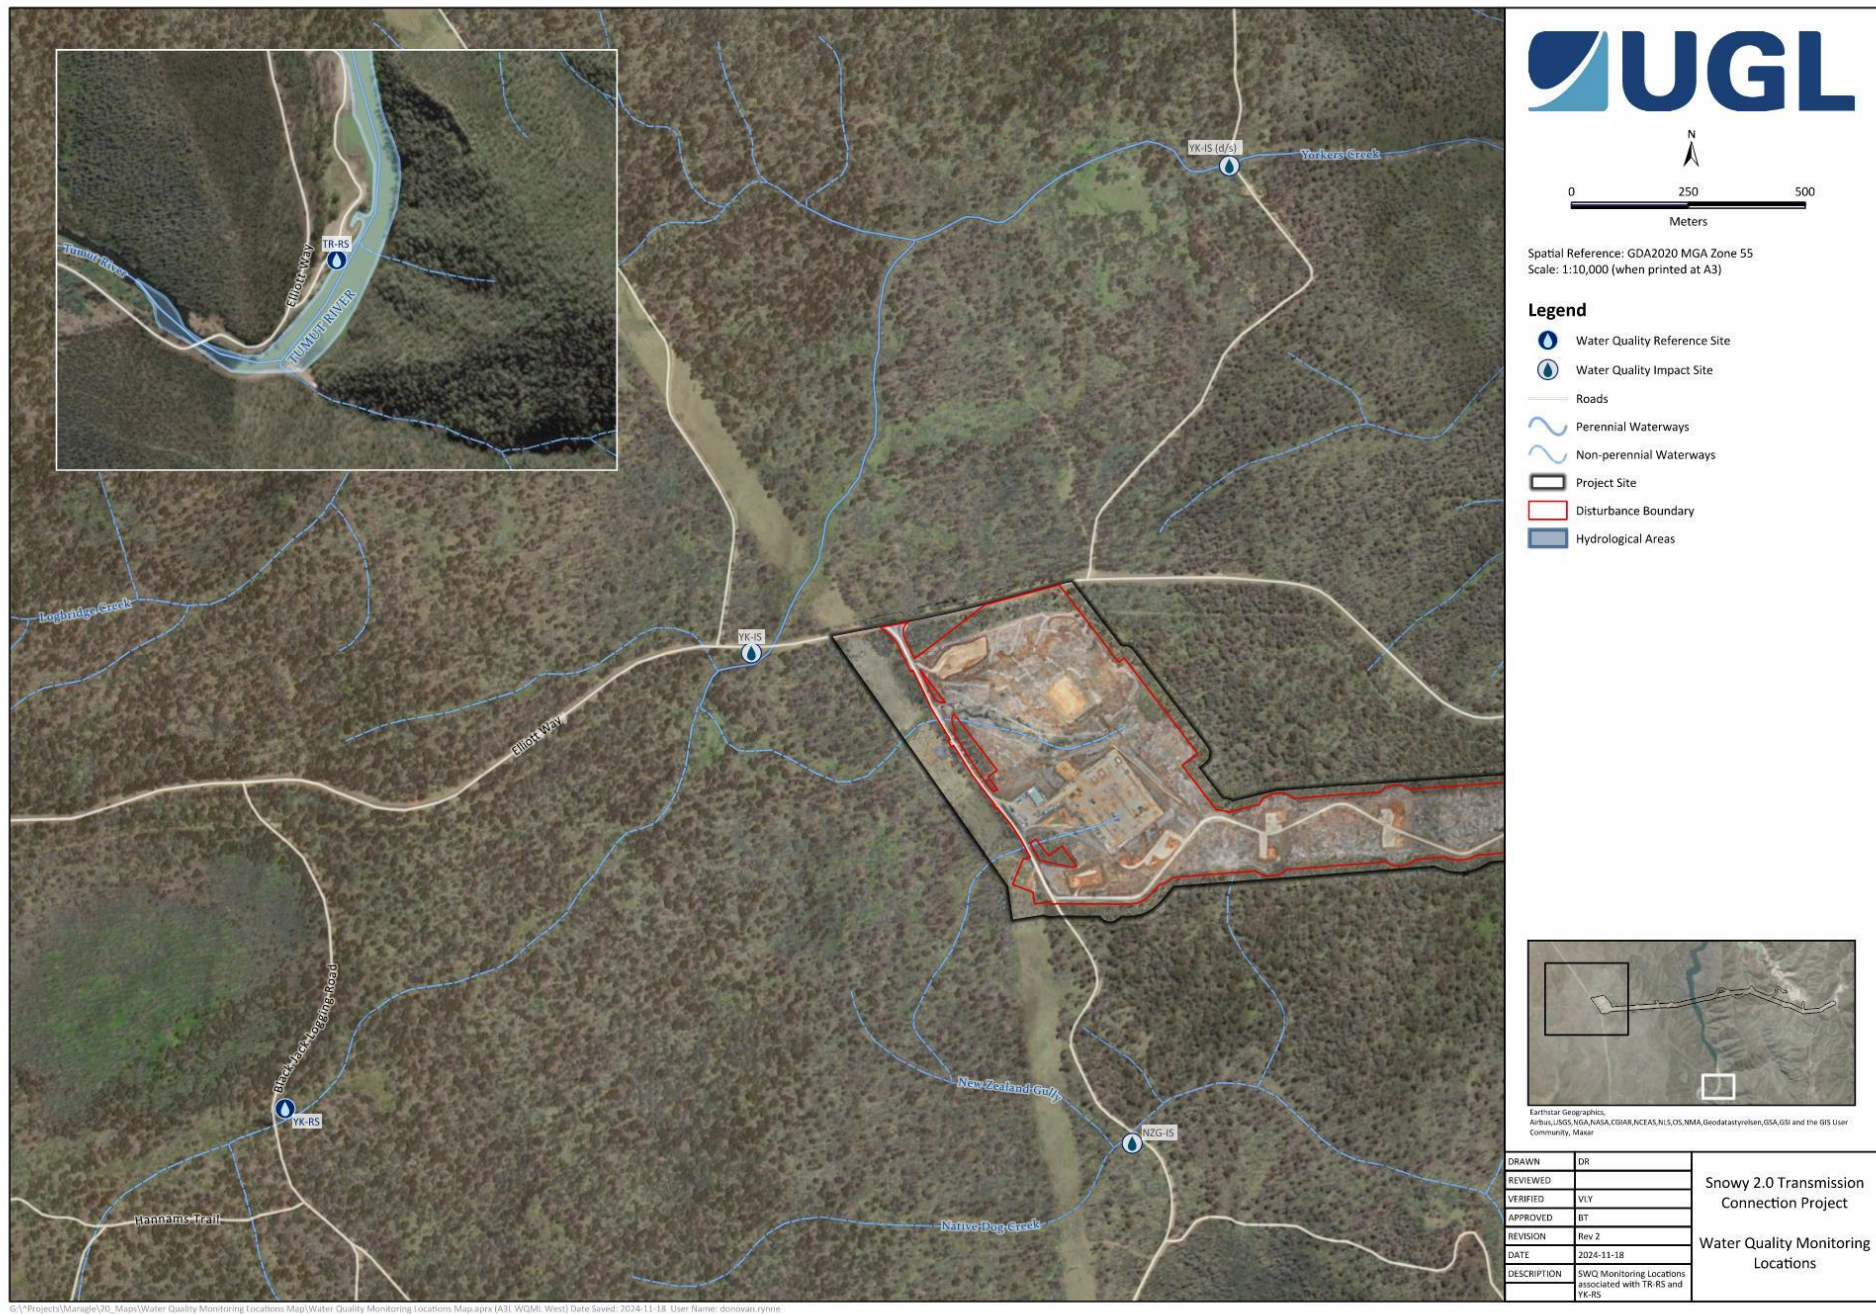


FIGURE 2 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE YR-RS AND TR-RS IN RELATION TO THE PROJECT



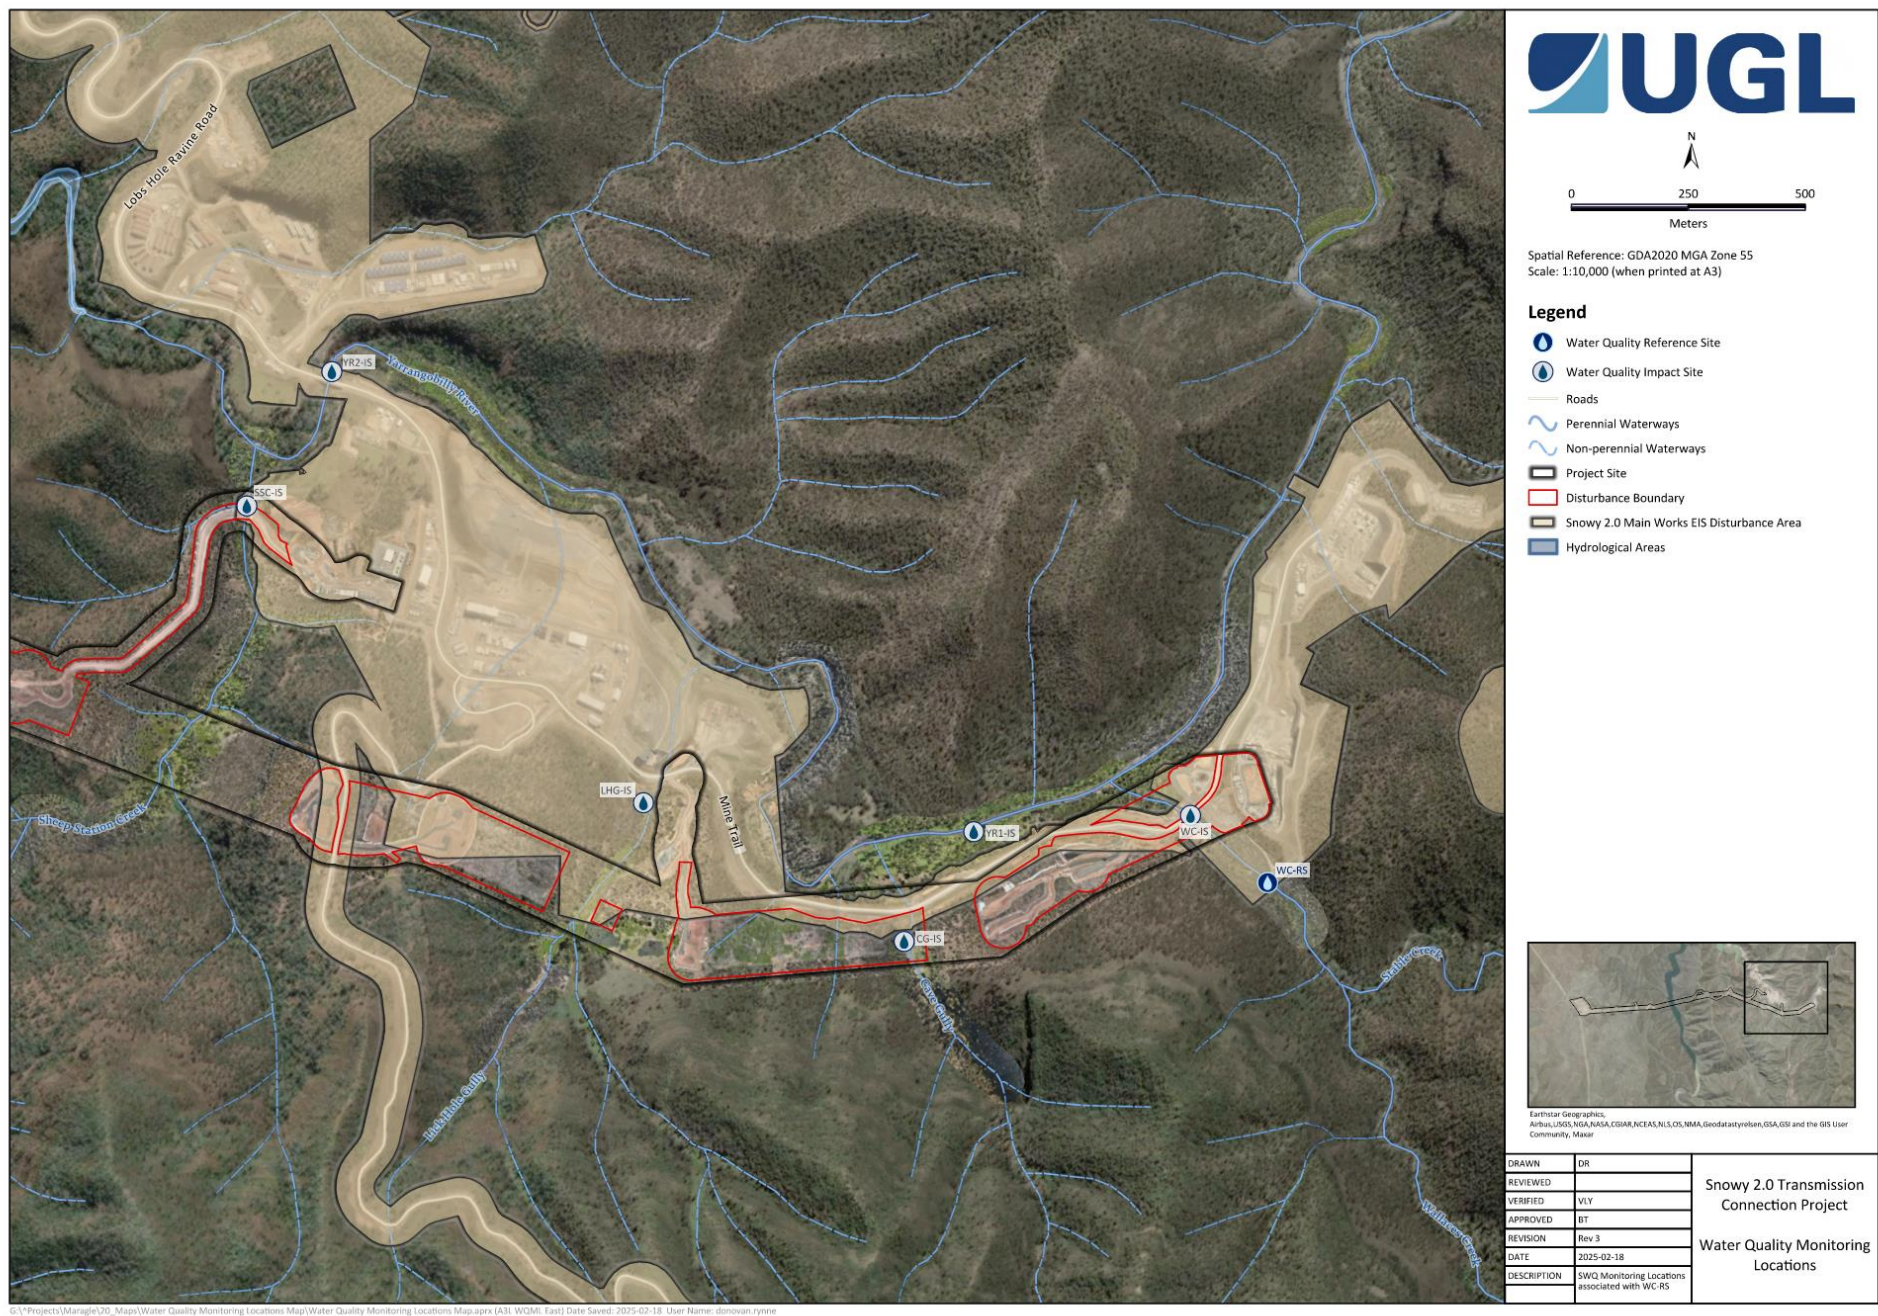


FIGURE 3 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE WC-RS IN RELATION TO THE PROJECT

Table 2 Seasonal SSGV (NGH, 2024) and DGV (ANZG, 2018) for water quality parameters

SURFACE WATER QUALITY GUIDELINE VALUES								
Parameter	Unit	WC-RS		TR-RS		YK-RS		DGV
		SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	
Temperature	°C*	-	-	-	-	-	-	-
Dissolved Oxygen (DO) ***	%#	96.2	89.7	91.3	95.5	89.6	88.7	90-110
DO	ppm <sup>+</sup>	9.08	10.28	8.79	11.53	8.35	10.2	-
Specific Electrical Conductivity (EC)***	SPC <sup>^</sup> μS/cm <sup>^^</sup>	115	88	24	38.7	31	27.9	30-350
EC***	μS/cm	93.2	60.85	20.3	26.2	24	20.5	30-350
pH***	-	7.85	7.62	7.59	7.59	6.79	6.61	6.5-8
Redox	mV <sup>##</sup>	79.1	98.4	91.2	95.4	94.6	106.1	-
Turbidity***	NTU <sup>**</sup>	0.37	5.12	0.09	1.56	9	7.87	2-25
Dissolved Aluminium (Al)	mg/L <sup>++</sup>	0.03	0.04	0.03	0.015	0.36	0.32	0.027
Dissolved Arsenic (As)	mg/L	0.003	0.0003	0.003	0.0003	0.003	0.0003	0.0008
Dissolved Cadmium (Cd)	mg/L	0.00002	0.00002	0.00002	0.00002	0.00002	0.00002	0.0006
Dissolved Chromium (Cr)	mg/L	0.00001	0.00001	0.00001	0.00001	0.00001	0.00001	0.00001
Dissolved Copper (Cu)	mg/L	0.0002	0.0002	0.0002	0.0002	0.0002	0.0002	0.001
Cyanide	mg/L	0.002	0.002	0.002	0.002	0.002	0.002	0.004
Dissolved Iron (Fe)	mg/L	0.03	0.02	0.04	0.02	0.41	0.23	0.3
Dissolved Lead (Pb)	mg/L	0.001	0.001	0.001	0.001	0.001	0.001	0.001
Dissolved Manganese (Mn)	mg/L	0.002	0.002	0.003	0.002	0.005	0.003	1.2
Dissolved Mercury (Hg)	mg/L	0.00003	0.00003	0.00003	0.00003	0.00003	0.00003	0.00006

## SURFACE WATER QUALITY GUIDELINE VALUES

Parameter	Unit	WC-RS		TR-RS		YK-RS		DGV
		SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	
Dissolved Nickel (Ni)	mg/L	0.001	0.001	0.001	0.001	0.001	0.001	0.008
Total Nitrogen (TN)	mg/L	0.2	0.2	0.2	0.2	0.2	0.2	0.25
Total Phosphorus (TP)	mg/L	0.02	0.02	0.02	0.02	0.02	0.02	0.02
Dissolved Silver (Ag)	mg/L	0.00002	0.00002	0.00002	0.00002	0.00002	0.00002	0.00002
Dissolved Zinc (Zn)	mg/L	0.002	0.002	0.002	0.002	0.002	0.002	0.0024
Ammonia	mg/L	0.013	0.013	0.013	0.013	0.013	0.013	0.013
Nitrogen Oxides	mg/L	0.015	0.015	0.015	0.015	0.015	0.015	0.015
Reactive Phosphorus (RP)	mg/L	0.02	0.015	0.02	0.015	0.02	0.02	0.015
Total Hardness (CaCO <sub>3</sub> )	mg/L	47	30	7.5	8	1	7	-
Total Kjeldahl Nitrogen (TKN)	mg/L	0.2	0.2	0.1	0.2	0.1	0.2	-
Total Dissolved Solids (TDS)	mg/L	52	39	12.5	15	30	10	-
Total Suspended Solids (TSS)	mg/L	0.2	1	0.2	0.2	3	0.2	0.2
Total Al <sup>@</sup>	mg/L	-	-	-	-	-	-	0.027
Total As <sup>@</sup>	mg/L	-	-	-	-	-	-	0.0008
Total Cd <sup>@</sup>	mg/L	-	-	-	-	-	-	0.0006
Total Cr <sup>@</sup>	mg/L	-	-	-	-	-	-	0.00001
Total Cu <sup>@</sup>	mg/L	-	-	-	-	-	-	0.001
Total Pb <sup>@</sup>	mg/L	-	-	-	-	-	-	0.001
Total Mn <sup>@</sup>	mg/L	-	-	-	-	-	-	1.2
Total Ni <sup>@</sup>	mg/L	-	-	-	-	-	-	0.008

## SURFACE WATER QUALITY GUIDELINE VALUES

Parameter	Unit	WC-RS		TR-RS		YK-RS		DGV
		SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	
Total Ag <sup>@</sup>	mg/L	-	-	-	-	-	-	0.00002
Total Zn <sup>@</sup>	mg/L	-	-	-	-	-	-	0.0024
Total Fe <sup>@</sup>	mg/L	-	-	-	-	-	-	0.3
Total Hg <sup>@</sup>	mg/L	-	-	-	-	-	-	0.00006

\* °C = degrees Celsius

# % = percent

### mV = millivolt

+ ppm = parts per million

^ SPC = specific conductance

\*\* mg/L = milligram per litre

\*\* NTU = Nephelometric Turbidity Unit

^^ µS/cm = micro Siemens per centimetre

@ parameter not analysed by NGH

\*\*\* assessed against DGV where guideline range is more appropriate for the parameter



## 4. BASELINE WATER QUALITY

### 4.1. Water Quality Objectives

Water quality objectives are outlined in Section 2.1 of the Baseline Report (NGH, 2024).

### 4.2. Site Specific Guideline Values

In accordance with the ANZG (ANZG, 2018), SSGV for the three Reference Sites (RS) (WC-RS, TR-RS and YK-RS) were derived from the results collected during the 24 month pre-construction SWQ monitoring period. The SSGV reflect the seasonality observed in the baseline data and are characterised by the drier months of Summer/Autumn (December to May) and wetter months of Winter/Spring (June to November) in accordance with the 'Australian and New Zealand Environment and Conservation Council (ANZECC) and Agriculture and Resource Management Council of Australia and New Zealand (ARMCANZ) (2000) methodology and derivatives developed to 2018 of the ANZG (ANZG, 2018).

Table 2 outlines the seasonal SSGV provided in the Baseline Report (NGH, 2024).



## 5. DECEMBER 2024 MONITORING

SW sampling was undertaken at 12 monitoring locations on 10 November 2024.


In accordance with the methodology outlined in Section 3, SW samples were either measured in situ using a calibrated YSI ProDSS Sonde Multiparameter Digital Water Quality Meter (refer to Appendix D) or analysed by National Association of Testing Authorities, Australia (NATA) accredited ALS Limited (ALS) laboratory.

The 'Water Quality Monitoring Field Data Sheet' (Field Sheet) (UGL, 2024) is provided in Appendix A. The 'Certificate of Analysis' (COA) (ALS, 2024a), 'QA/QC Compliance Assessment to assist with Quality Review' (QA/QC Assessment) (ALS, 2024b) and 'Quality Control Report' (QCR) (ALS, 2024c) are attached in Appendix B.




### 5.1. Observations

Field observations during sampling are summarised in Table 3.

**Table 3 Field observations during sampling**




FIELD OBSERVATIONS		
Date	10.12.24	
Weather	<p>Weather forecast for 10 December was 5% chance of &lt;1 millimetre (mm) rainfall with wind gusts up to 7 kilometres per hour (km/h) (DTN, 2024). 0.3 mm of rainfall was recorded on 9 December. However, the Cabramurra region experienced a major rainfall event, approximately 85 mm, between 5 to 7 December.</p> <p>During sampling, weather conditions were dry, warm and sunny. No rainfall observed.</p>	
ID	Observations	Photo
WC-RS	<ul style="list-style-type: none"> <li>Visible sheen from organic decomposition on surface of water along edge of bank</li> <li>Eroded bank from root system of large tree</li> <li>Water had very minimal milky tinge</li> <li>High density of vegetation along both banks</li> <li>Water had high flow rate</li> <li>Weeds include Blackberry (<i>Rubus fruticosus</i>)</li> <li>Some vegetative debris in the water along edge of bank</li> </ul>	

## FIELD OBSERVATIONS




Date	10.12.24	
Weather	<p>Weather forecast for 10 December was 5% chance of &lt;1 millimetre (mm) rainfall with wind gusts up to 7 kilometres per hour (km/h) (DTN, 2024). 0.3 mm of rainfall was recorded on 9 December. However, the Cabramurra region experienced a major rainfall event, approximately 85 mm, between 5 to 7 December.</p> <p>During sampling, weather conditions were dry, warm and sunny. No rainfall observed.</p>	
ID	Observations	Photo
WC-IS	<ul style="list-style-type: none"> <li>High density of weeds including Blackberry (<i>Rubus fruticosus</i>), Dandelions (<i>Taraxacum</i> sp.) and St John's Wort (<i>Hypericum perforatum</i>)</li> <li>Weeds growing in water upstream</li> <li>Water had high flow rate</li> <li>Some vegetative debris in the water</li> </ul>	
CG-IS	<ul style="list-style-type: none"> <li>Water had high flow rate</li> <li>High density of weeds including St John's Wort (<i>Hypericum perforatum</i>) and grass (<i>Poaceae</i>) species</li> <li>Vegetation growing in water</li> <li>Water was very clear</li> <li>Some vegetative debris in the water</li> <li>Exposed and eroded rocky banks</li> <li>Water runs adjacent to historic metal pipe</li> <li>Riparian vegetation mostly consist of groundcover vegetation</li> </ul>	
YR1-IS	<ul style="list-style-type: none"> <li>Milky colouration to water</li> <li>Some eroded banks but mostly densely vegetated</li> <li>Vegetation along banks include Blackberry (<i>Rubus fruticosus</i>) weed</li> <li>Low visibility to bed</li> <li>Higher volume of water than previous months</li> </ul>	



## FIELD OBSERVATIONS



Date	10.12.24	
Weather	<p>Weather forecast for 10 December was 5% chance of &lt;1 millimetre (mm) rainfall with wind gusts up to 7 kilometres per hour (km/h) (DTN, 2024). 0.3 mm of rainfall was recorded on 9 December. However, the Cabramurra region experienced a major rainfall event, approximately 85 mm, between 5 to 7 December.</p> <p>During sampling, weather conditions were dry, warm and sunny. No rainfall observed.</p>	
ID	Observations	Photo
LHG-IS	<ul style="list-style-type: none"> <li>• Very shallow depth</li> <li>• Higher flow rate and volume than previous months</li> <li>• Dense vegetation, including weeds, in and around water</li> <li>• Fine sediment on bed</li> <li>• Water is clear with slight yellow tinge</li> </ul>	
YR2-IS	<ul style="list-style-type: none"> <li>• Milky colouration to water</li> <li>• Vegetation along banks</li> <li>• High flow rate</li> <li>• Higher volume than previous months</li> <li>• High density of weeds including Blackberry (<i>Rubus fruticosus</i>) and St John's Wort (<i>Hypericum perforatum</i>)</li> <li>• No visibility to bed</li> <li>• Large branch present in water at sampling point</li> </ul>	
SSC-IS	<ul style="list-style-type: none"> <li>• Milky colouration to water</li> <li>• Dense vegetation, including weeds Blackberry (<i>Rubus fruticosus</i>) and St John's Wort (<i>Hypericum perforatum</i>), along banks</li> <li>• Eroded portions of bank from runoff resulting from previous rainfall events</li> <li>• Shallow depth</li> <li>• Higher volume and flow rate compared to previous months</li> <li>• Brown tinge to water</li> </ul>	

## FIELD OBSERVATIONS

Date	10.12.24	
Weather	<p>Weather forecast for 10 December was 5% chance of &lt;1 millimetre (mm) rainfall with wind gusts up to 7 kilometres per hour (km/h) (DTN, 2024). 0.3 mm of rainfall was recorded on 9 December. However, the Cabramurra region experienced a major rainfall event, approximately 85 mm, between 5 to 7 December.</p> <p>During sampling, weather conditions were dry, warm and sunny. No rainfall observed.</p>	
ID	Observations	Photo
TR-RS	<ul style="list-style-type: none"> <li>• Clear water but no visibility at depth</li> <li>• Low flow rate</li> <li>• Densely vegetated along banks</li> <li>• Ducks present upstream</li> <li>• Some weeds present along banks</li> <li>• Small vegetative debris floating on surface of water</li> <li>• Sampling point is located at O'Hares Campground, a popular recreational area for swimming, fishing and boating</li> <li>• Ancillary infrastructure associated with Talbingo Reservoir is upstream and in proximity of the sampling point</li> </ul>	
YK-RS	<ul style="list-style-type: none"> <li>• Water had brown tinge</li> <li>• Fine sediment, including mica, at bed</li> <li>• Eroded banks upstream</li> <li>• Tadpoles present in water</li> <li>• Banks mostly consist of groundcover vegetation</li> <li>• Kangaroo scats around waterway</li> <li>• Water visibly flowing with bubbles along the surface</li> <li>• Low presence of noxious weeds including Blackberry (<i>Rubus fruticosus</i>)</li> <li>• Vegetative debris in water</li> </ul>	
YK-IS (D/S)	<ul style="list-style-type: none"> <li>• Slight milky colouration but otherwise clear water with light brown tinge</li> <li>• Dense vegetation cover along banks</li> <li>• Vegetative debris in water</li> <li>• High flow rate</li> <li>• Presence of algae on rocks in bed</li> <li>• Mica in bed</li> </ul>	



## FIELD OBSERVATIONS

Date	10.12.24	
Weather	<p>Weather forecast for 10 December was 5% chance of &lt;1 millimetre (mm) rainfall with wind gusts up to 7 kilometres per hour (km/h) (DTN, 2024). 0.3 mm of rainfall was recorded on 9 December. However, the Cabramurra region experienced a major rainfall event, approximately 85 mm, between 5 to 7 December.</p> <p>During sampling, weather conditions were dry, warm and sunny. No rainfall observed.</p>	
ID	Observations	Photo
NZG-IS	<ul style="list-style-type: none"> <li>• Dense vegetation along banks</li> <li>• Presence of fish (potentially two species) and water beetles (<i>Dytiscidae</i> sp.)</li> <li>• Presence of algae on rocks in bed</li> <li>• Mica in bed</li> <li>• Vegetative debris in water</li> <li>• Shallow depth</li> <li>• Hoof tracks along banks</li> <li>• Vegetation overhanging waterway</li> </ul>	
YK-IS	<ul style="list-style-type: none"> <li>• Eroded banks upstream</li> <li>• Fine sediment, including mica, at bed</li> <li>• Vegetative debris in water</li> <li>• Horse (<i>Equus ferus caballus</i>) manure observed along bank</li> <li>• Banks mostly consist of groundcover vegetation</li> <li>• Water visibly flowing</li> <li>• Water had milky colouration with yellow tinge</li> </ul>	

## 5.2. Results

The results from the construction SWQ monitoring program have been reported for each respective catchment: Yarrangobilly River, Talbingo Reservoir, and Yorkers Creek.

- **Yarrangobilly River catchment** monitoring includes the reference site at Wallace Creek and impact sites at Yarrangobilly River, Wallace Creek, Cave Gully, Lick Hole Gully, and Sheep Station Creek.
- **Yorkers Creek catchment** monitoring includes the reference site at Yorkers Creek and impact sites at Yorkers Creek and New Zealand Gully.
- **Talbingo Reservoir** features a reference site located upstream within the reservoir, serving as an overall reference for monitoring sites in the Yarrangobilly River and Yorkers Creek catchments.

This reference site provides a baseline for the SWQ monitoring program.

The SWQ monitoring results for key physical and chemical parameters, along with site-specific trigger values, are detailed in Section 5.2.1. Results for dissolved and total metals, including site-specific trigger values, are covered in Sections 5.2.2 and 5.2.3. Upon review of the data, observations were noted between the reference and impact sites.

The complete table of results is attached in Appendix C.

### 5.2.1. Key Physical and Chemical Parameters

See below for results of key physical and chemical parameters.

## Temperature

In December 2024, majority of the temperatures (°C) in the Yarrangobilly River catchment rose compared to the previous month, ranging from 12.7 °C to 18.8 °C, with the exception of YR1-IS and YR2-IS, refer to Figure 4. Similarly, temperatures in the Talbingo Reservoir increased from 15.6 °C in November to 22.8 °C in December 2024, refer to Figure 5. In the Yorkers Creek catchment, temperatures ranged from 17.3 °C to 22.9 °C during December 2024 with NZG-IS increasing almost 5 °C since November, as illustrated in Figure 6.

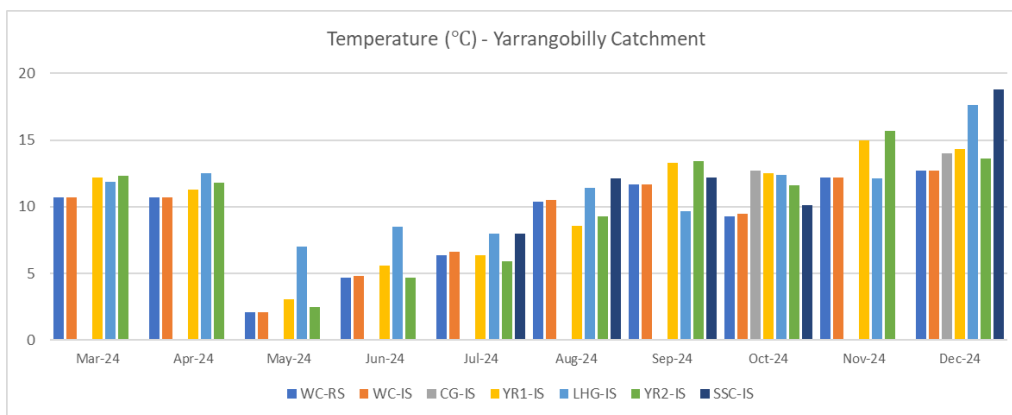


FIGURE 4 : TEMPERATURE FOR YARRANGOBILLY RIVER CATCHMENT

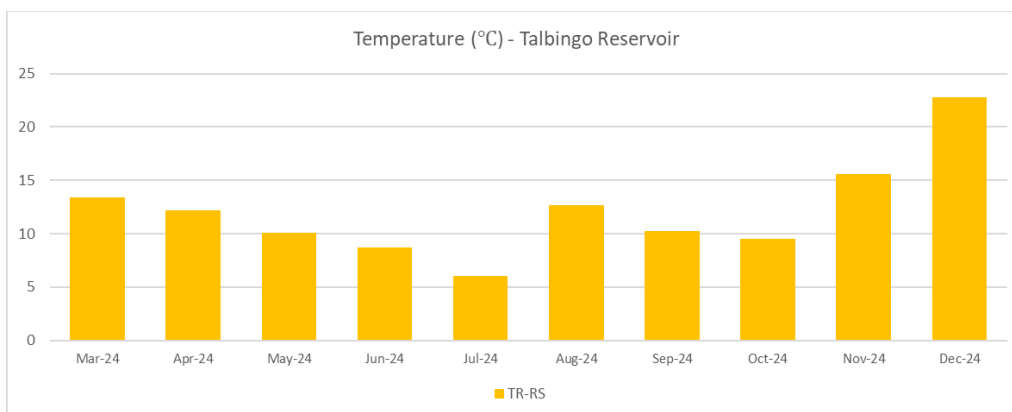


FIGURE 5: TEMPERATURE FOR TALBINGO RESERVOIR

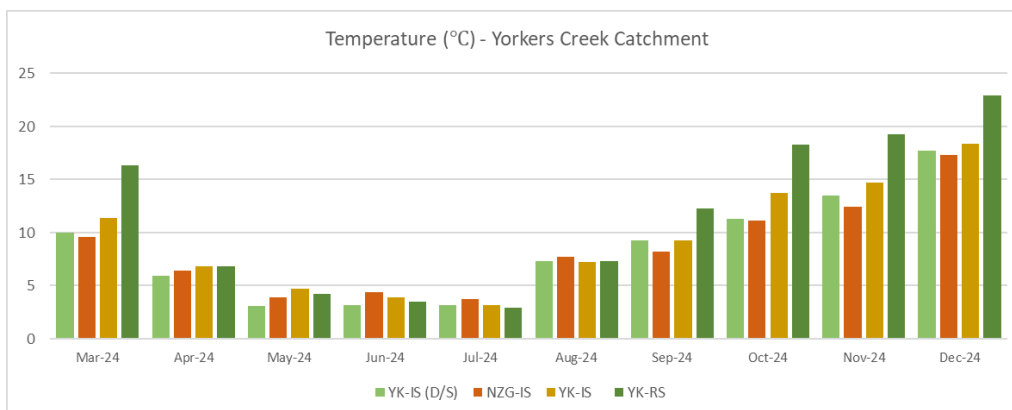


FIGURE 6: TEMPERATURE FOR YORKERS CREEK CATCHMENT

## pH

pH values exceeded the December to May SSGV (7.85) within the Yarrangobilly River catchment at CG-IS, LHG-IS and SSC-IS, refer Figure 7. Talbingo Reservoir and all sites within the Yorkers Creek catchment also exceeded their respective December to May SSGV, refer to Figure 8 and Figure 9.

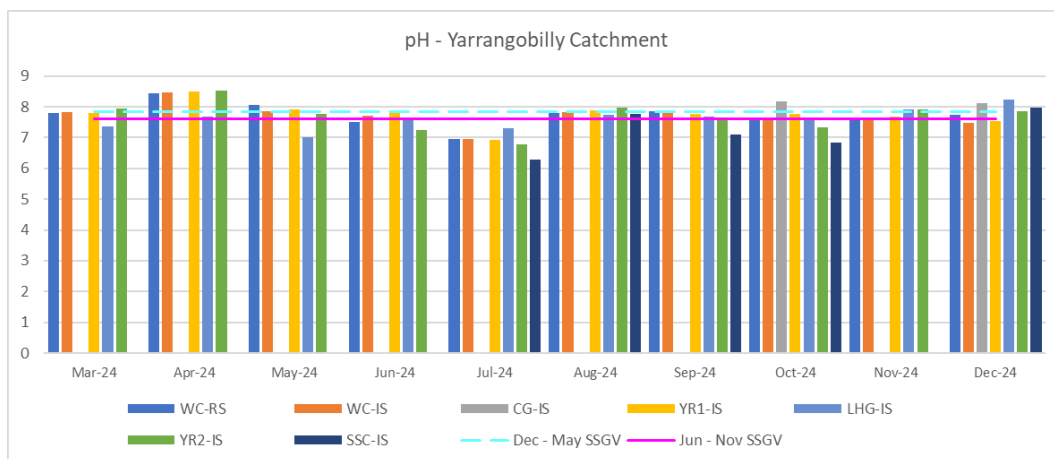


FIGURE 7: PH FOR YARRANGOBILLY RIVER CATCHMENT

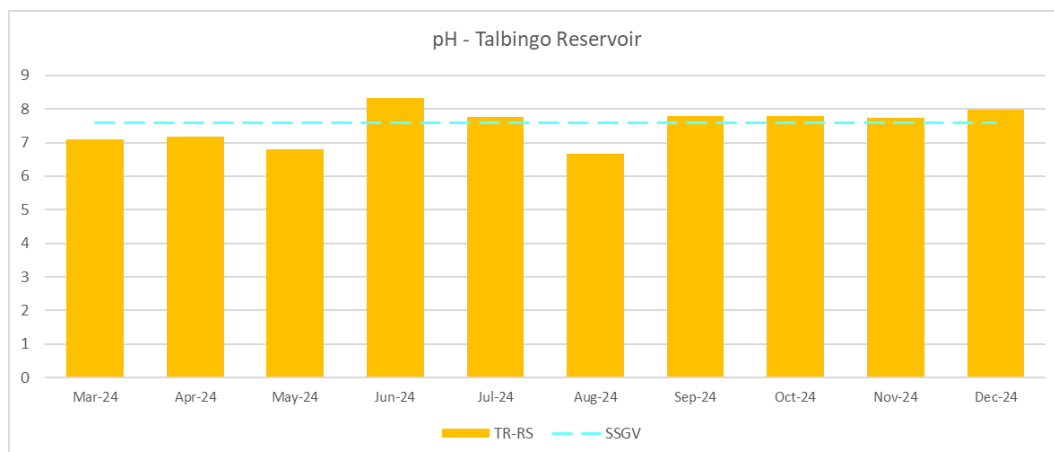


FIGURE 8: PH FOR TALBINGO RESERVOIR

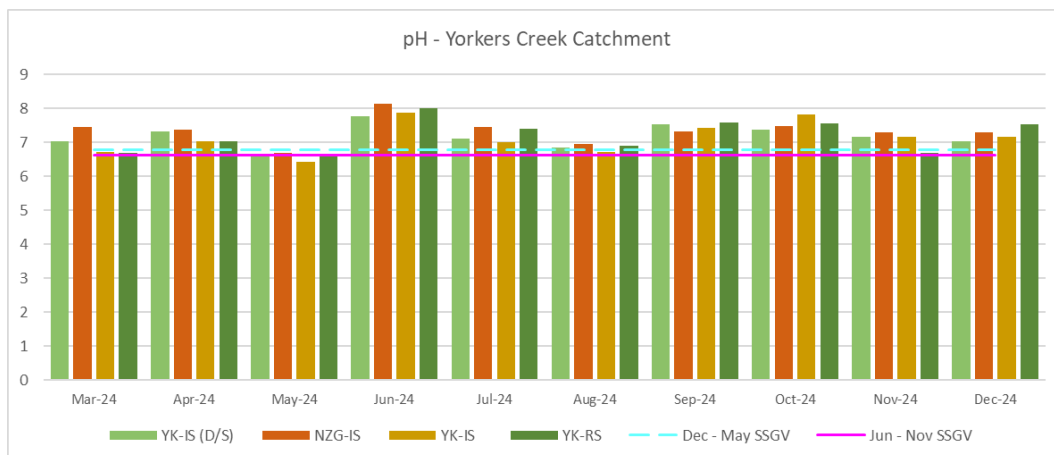


FIGURE 9: PH FOR YORKERS CREEK CATCHMENT



## Dissolved Oxygen

DO (%) levels in the Yarrangobilly River catchment and Yorkers Creek catchment were all below their respective December to May SSGV, refer Figure 10 and Figure 12. Talbingo Reservoir was the only monitoring location that measured above its SSGV, refer to Figure 11.

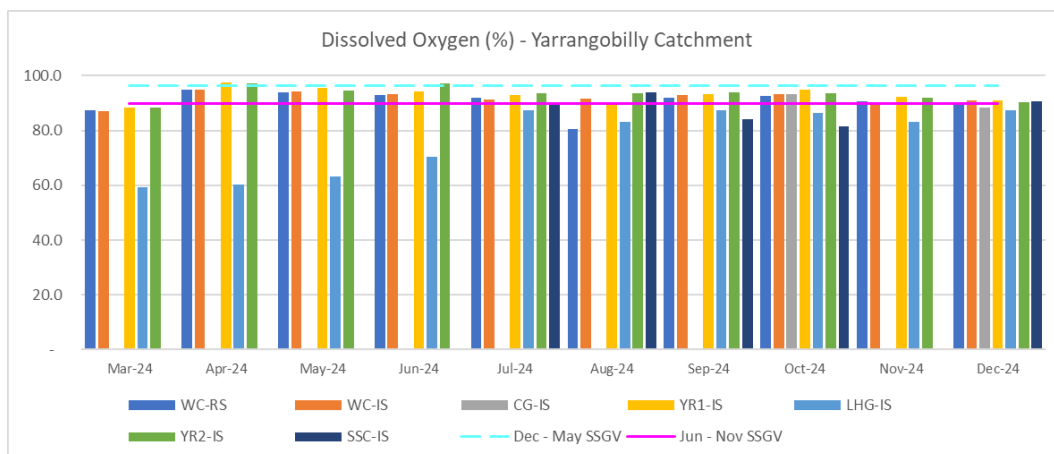


FIGURE 10: DO FOR YARRANGOBILLY RIVER CATCHMENT

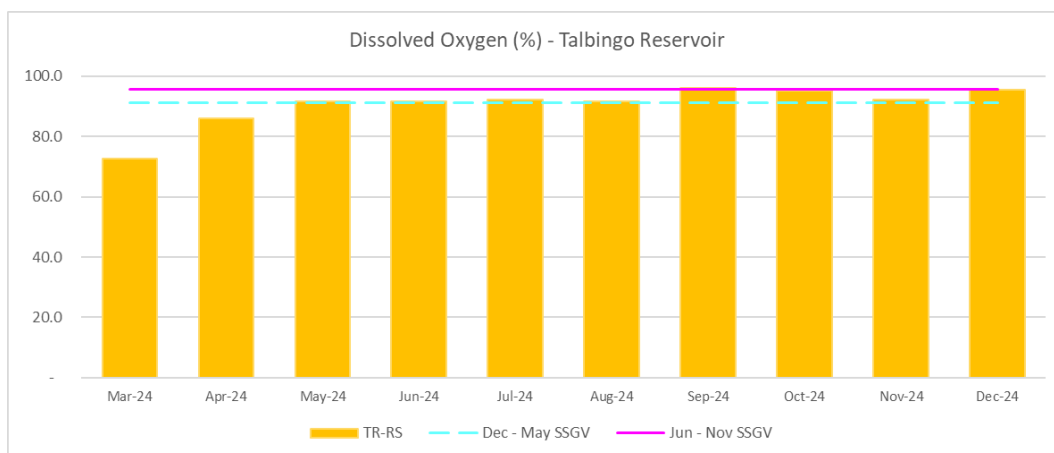


FIGURE 11: DO FOR TALBINGO RESERVOIR

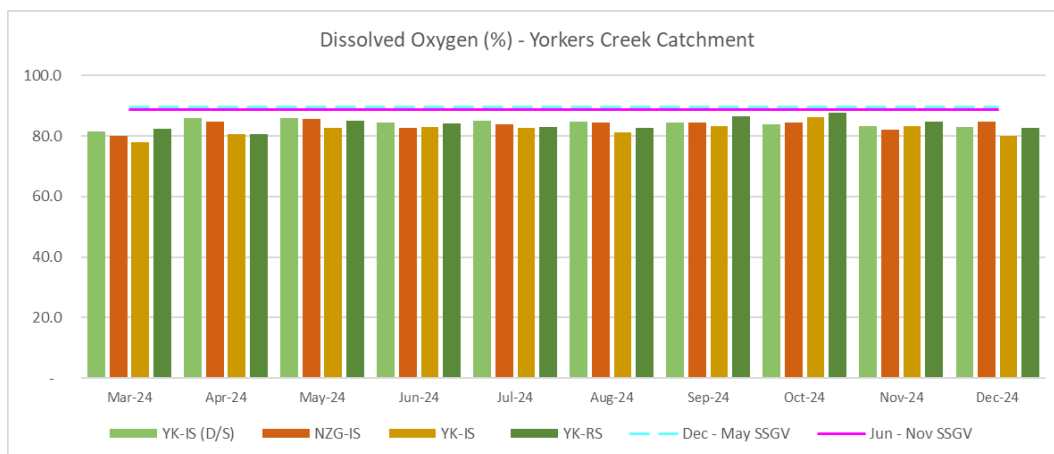


FIGURE 12: DO FOR YORKERS CREEK CATCHMENT

## Specific Conductance

The only SPC ( $\mu\text{S}/\text{cm}$ ) exceedance within the Yarrangobilly River catchment was LHG-IS at 278.1  $\mu\text{S}/\text{cm}$ , refer Figure 13. At Talbingo Reservoir, the SPC level was below the December to May SSGV of 24  $\mu\text{S}/\text{cm}$ , refer Figure 14. In the Yorkers Creek catchment, only NZG-IS exceeded the December to May SSGV, refer to Figure 15.

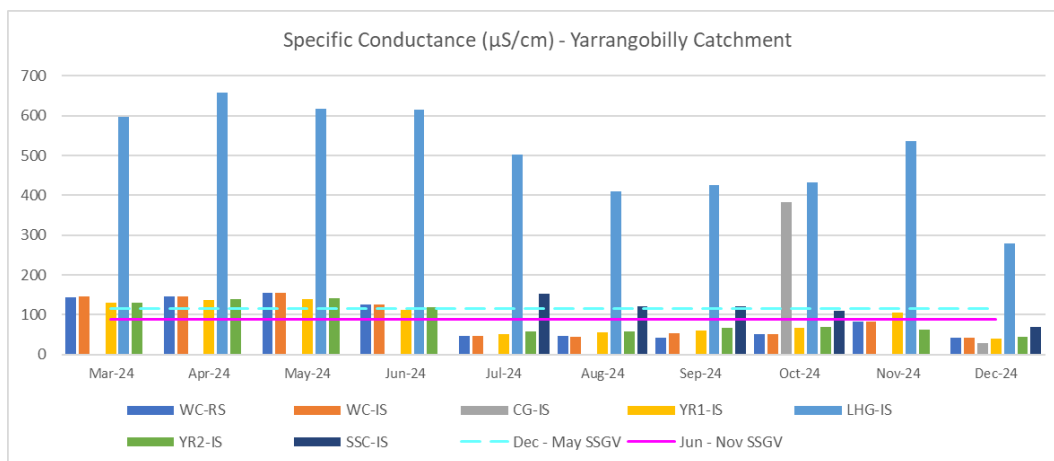


FIGURE 13: SPC FOR YARRANGOBILLY RIVER CATCHMENT

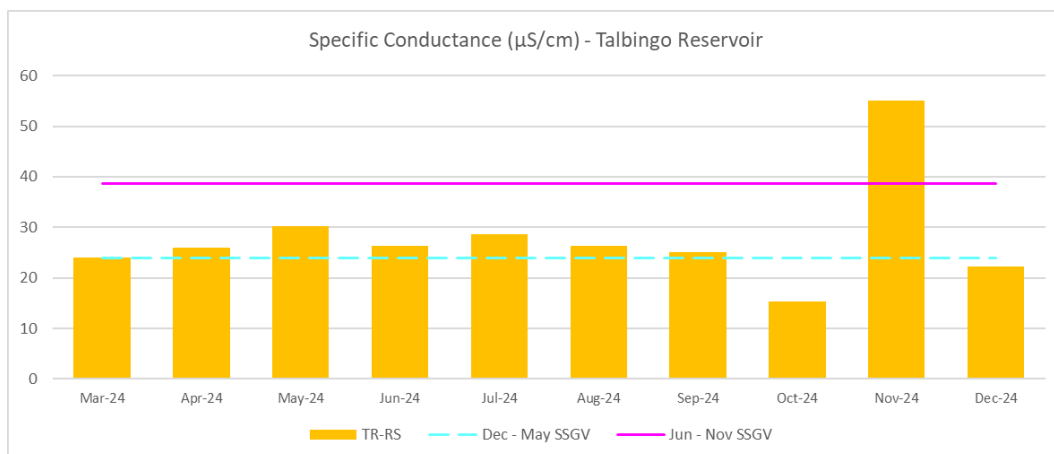


FIGURE 14: SPC FOR TALBINGO RESERVOIR

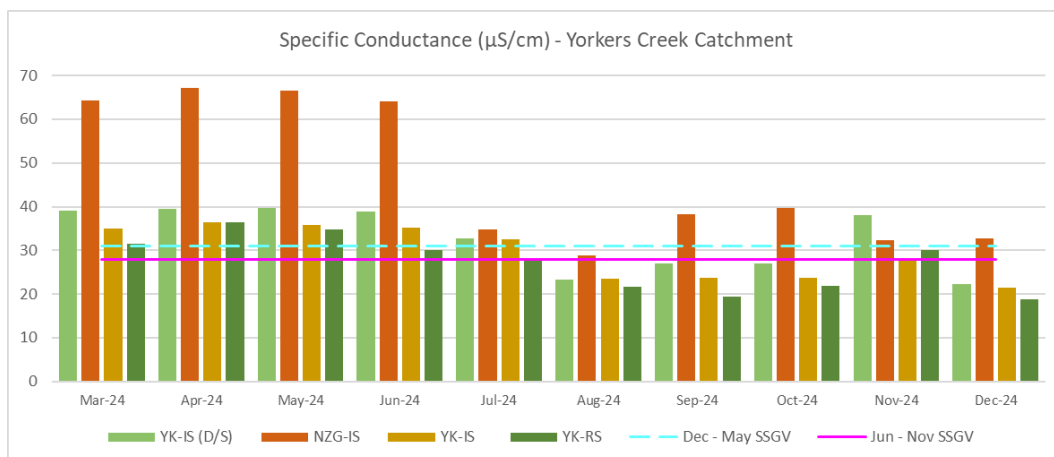


FIGURE 15: SPC FOR YORKERS CREEK CATCHMENT

## Electrical Conductivity

Exceedances of EC ( $\mu\text{S}/\text{cm}$ ) within the Yarrangobilly River catchment were seen in CG-IS, LHG-IS and SSC-IS, refer to Figure 16. EC for Talbingo Reservoir catchment and the Yorkers Creek catchment all exceeded their respective December to May SSGV, refer to Figure 17 and Figure 18. YK-IS (D/S) was significantly higher than the previous monitoring periods at 550  $\mu\text{S}/\text{cm}$ .

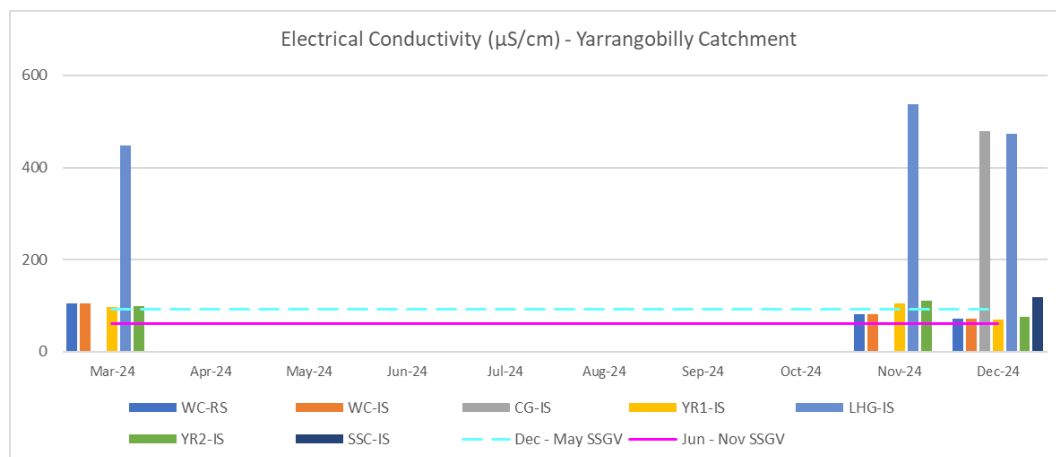


FIGURE 16: EC FOR YARRANGOBILLY RIVER CATCHMENT

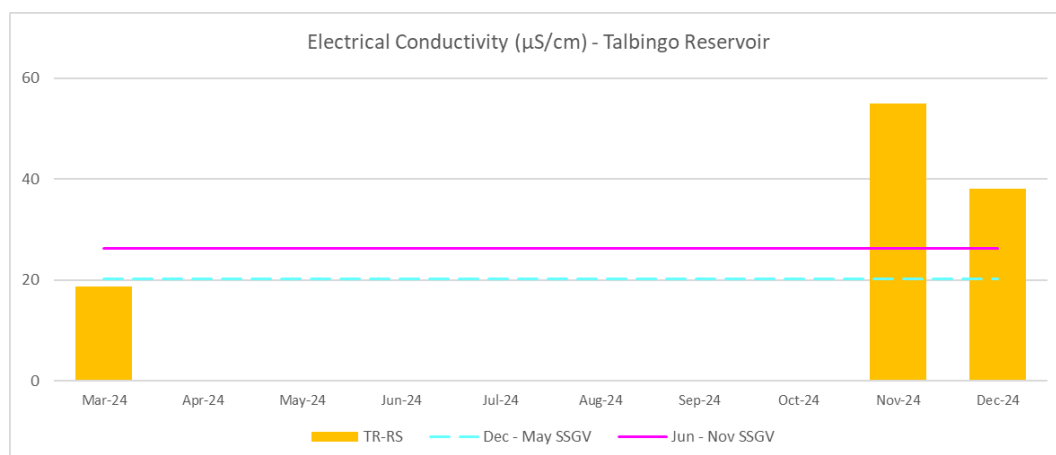


FIGURE 17: EC FOR TALBINGO RESERVOIR

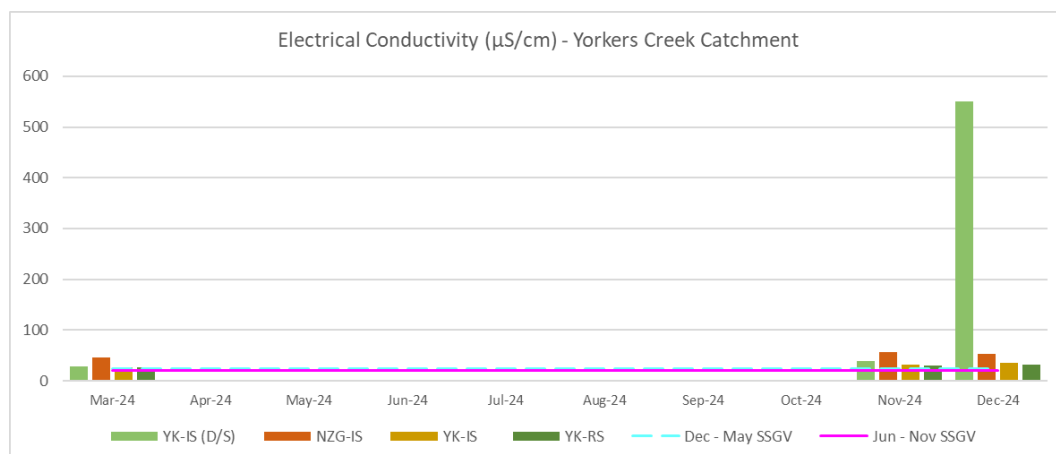


FIGURE 18: EC FOR YORKERS CREEK CATCHMENT

## Turbidity

Turbidity (NTU) levels exceeded the December to May SSGV at all sites across the three catchments except for YK-IS (D/S) and NZG-IS, refer Figure 19 to Figure 21. All readings increased from November 2024 with SSC-IS having the highest reading at 44.29 NTU.

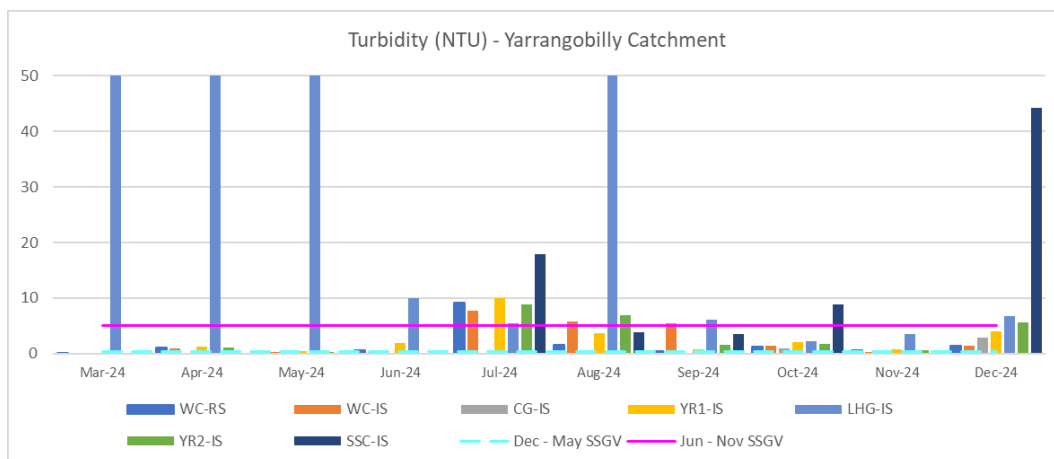


FIGURE 19: TURBIDITY FOR YARRANGOBILLY RIVER CATCHMENT

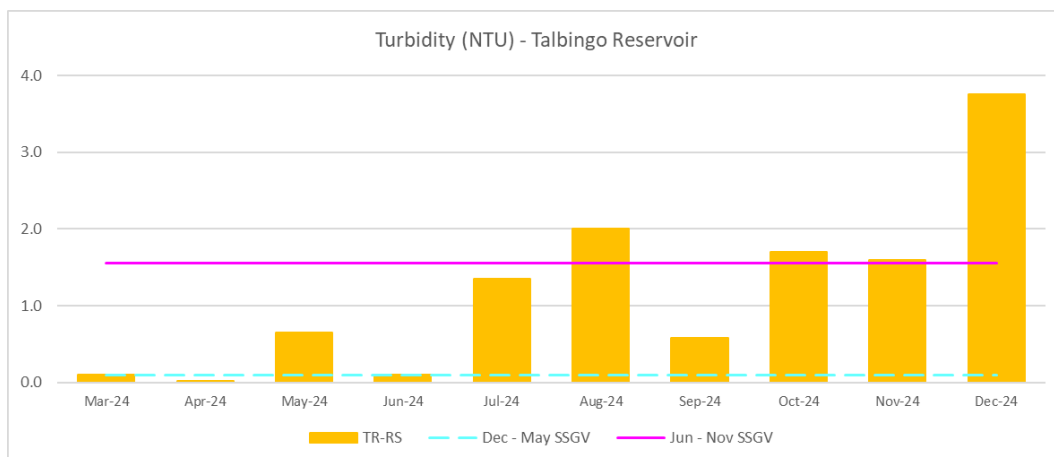


FIGURE 20: TURBIDITY FOR TALBINGO RESERVOIR

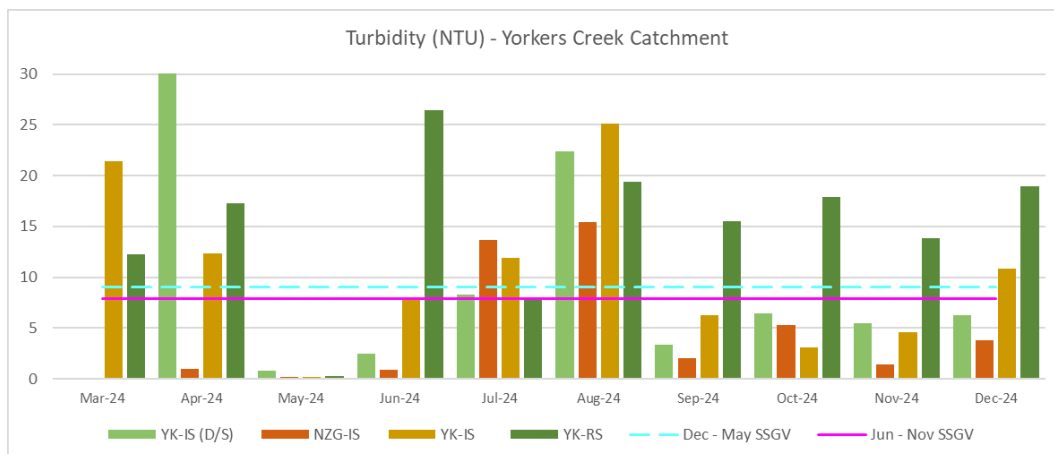


FIGURE 21: TURBIDITY FOR YORKERS CREEK CATCHMENT

## Total Suspended Solids

TSS (mg/L) levels exceeded the December to May SSGV (0.2 mg/L) at all reference and impact sites, except for CG-IS in the Yarrangobilly River catchment and NZG-IS in the Yorkers Creek catchment, refer to Figure 22 to Figure 24. CG-IS and NZG-IS were below the limit of reporting (LOR). The greatest exceedance in the Yarrangobilly River catchment was at SSC-IS with 8 mg/L. The greatest exceedance for Yorkers Creek catchment was at reference site YK-RS at 22 mg/L which was lower than the TSS recorded in November.

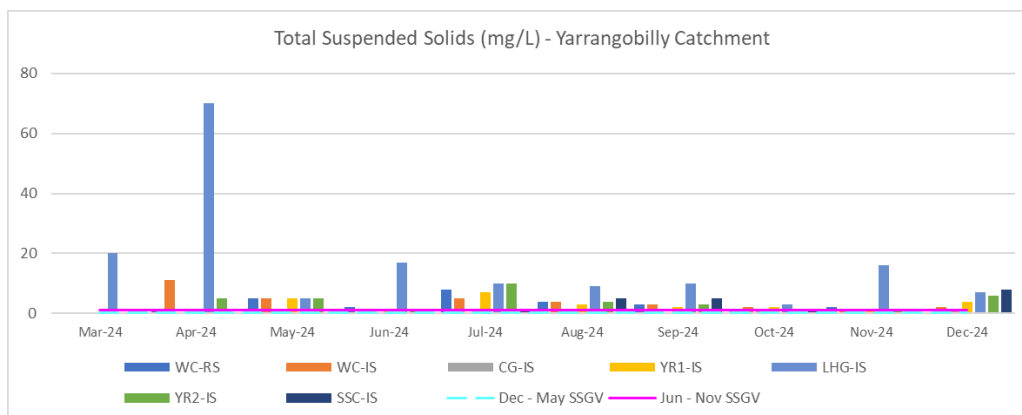


FIGURE 22: TSS FOR YARRANGOBILLY RIVER CATCHMENT

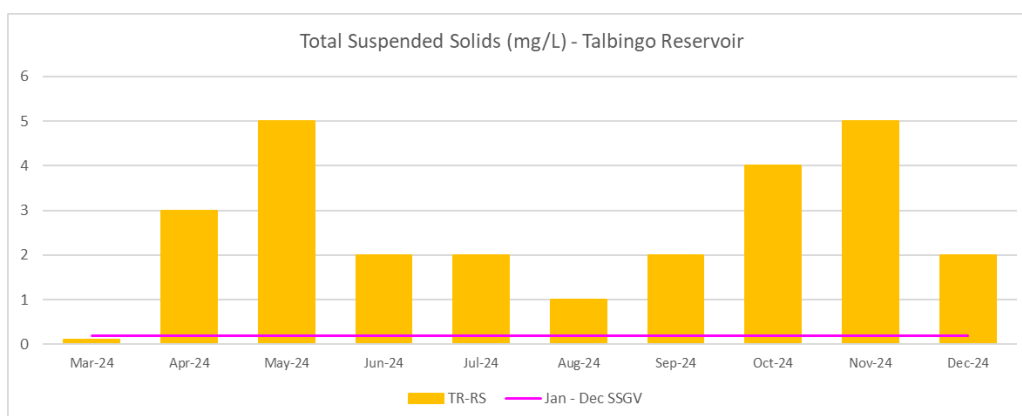


FIGURE 23: TSS FOR TALBINGO RESERVOIR

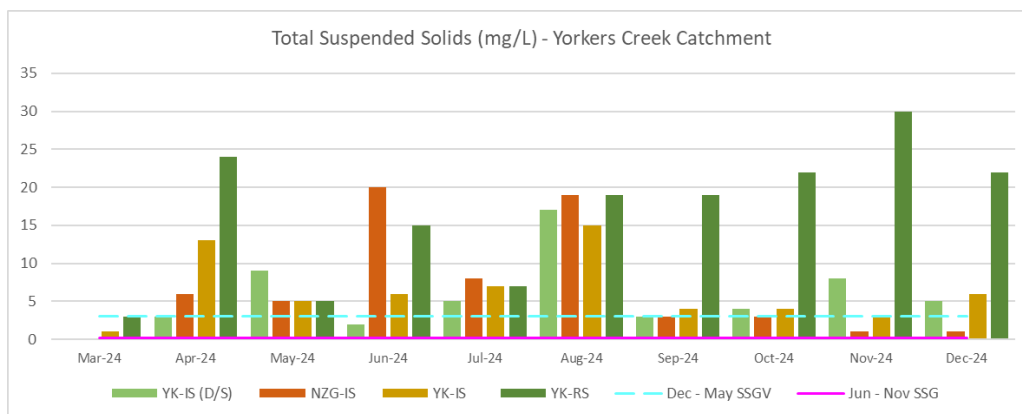


FIGURE 24: TSS FOR YORKERS CREEK CATCHMENT

## Redox

Redox (mV) for all sites were above the December to May SSGV for each catchment. December redox values were slightly higher than most recorded November values in the Yarrangobilly River catchment, refer to Figure 25. On the other hand, redox decreased in December compared to November for Talbingo Reservoir, refer to Figure 26. YK-RS and YK-IS decreased while YK-IS (D/S) and NZG-IS increased in December compared to November for Yorkers Creek catchment, refer to Figure 27.

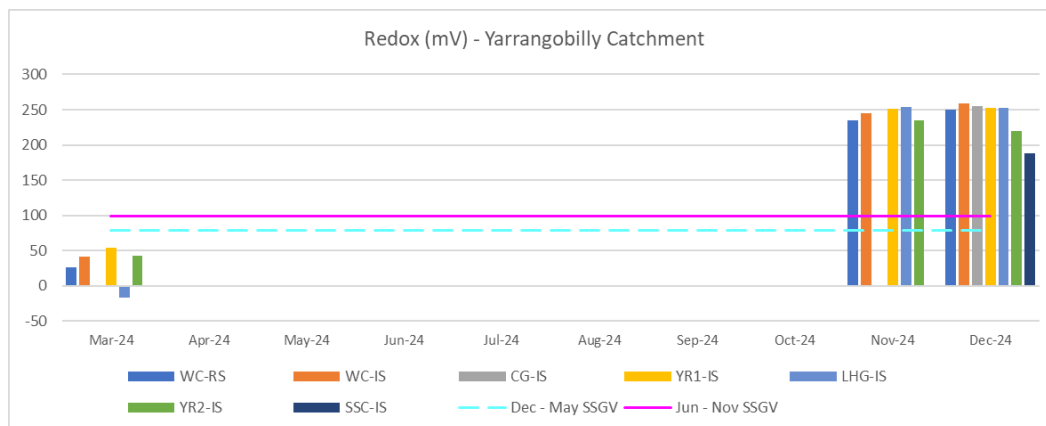


FIGURE 25: REDOX FOR YARRANGOBILLY RIVER CATCHMENT

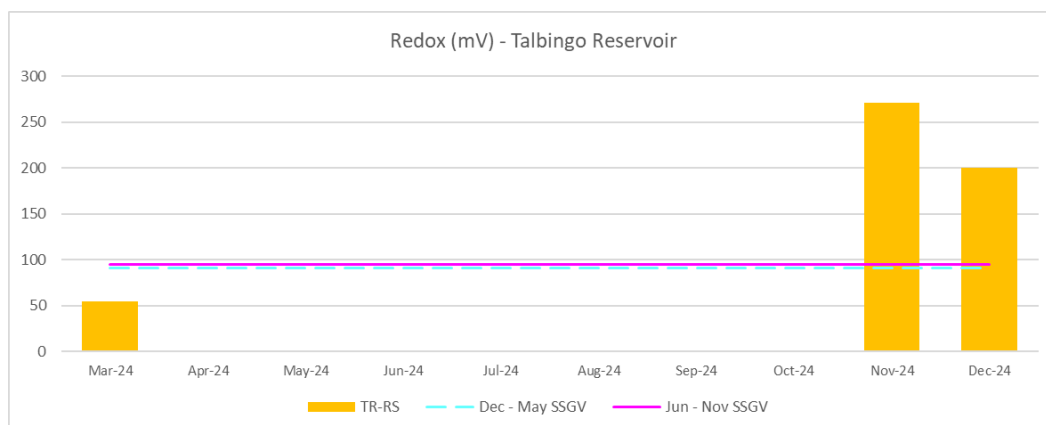


FIGURE 26: REDOX FOR TALBINGO RESERVOIR

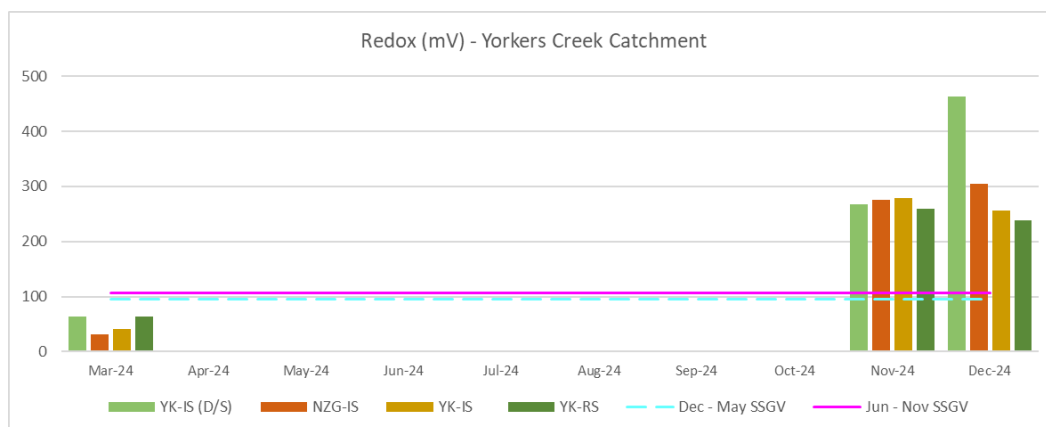


FIGURE 27: REDOX FOR YORKERS CREEK CATCHMENT

## Nitrogen Oxides

Nitrogen oxides (mg/L) levels exceeded the December to May SSGV (0.015 mg/L) at CG-IS, YR1-IS and YR2-IS of the Yarrangobilly River catchment, refer to Figure 28. Other sites of the Yarrangobilly River catchment were below the LOR. Similarly, Talbingo Reservoir was also below the LOR, refer to Figure 29. Exceedances were recorded at all Yorkers Creek catchment sites except for NZG-IS which recorded below the LOR, refer to Figure 30.

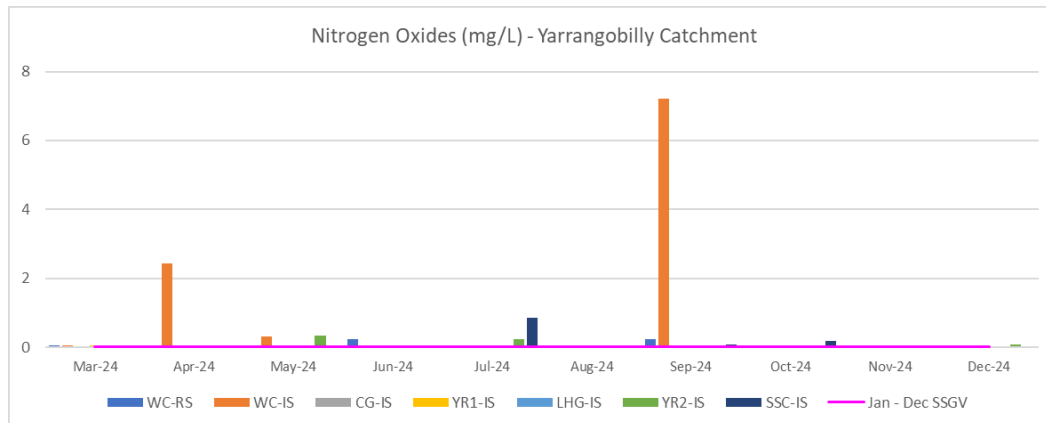


FIGURE 28: NITROGEN OXIDES FOR YARRANGOBILLY RIVER CATCHMENT

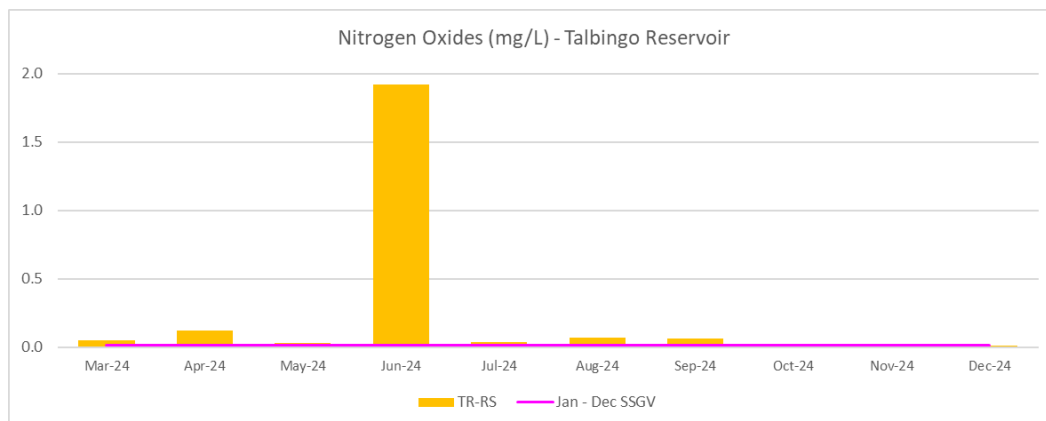


FIGURE 29: NITROGEN OXIDES FOR TALBINGO RESERVOIR

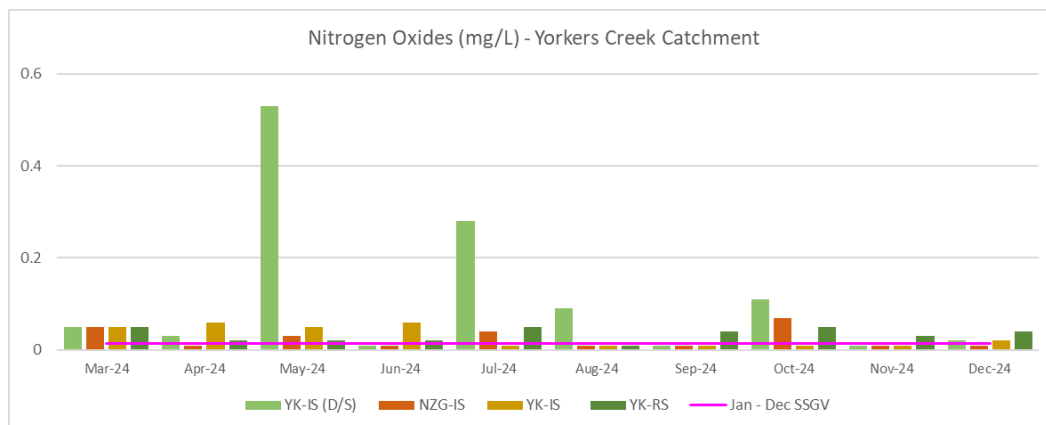


FIGURE 30: NITROGEN OXIDES FOR YORKERS CREEK CATCHMENT

## Ammonia

Ammonia (mg/L) levels exceeded the December to May SSGV (0.013 mg/L) at YR2-IS and YK-IS, both measuring 0.020 mg/L. All other sites were below the LOR, refer Figure 31 to Figure 33.

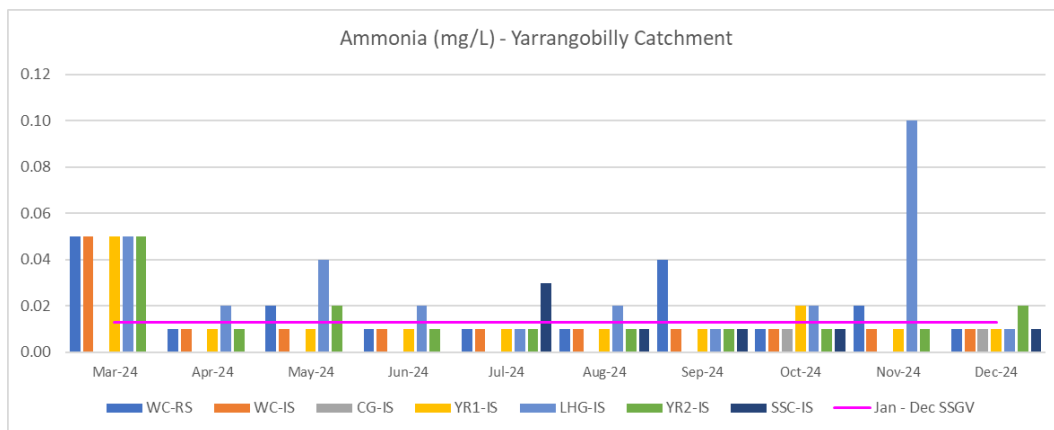


FIGURE 31: AMMONIA FOR YARRANGOBILLY RIVER CATCHMENT

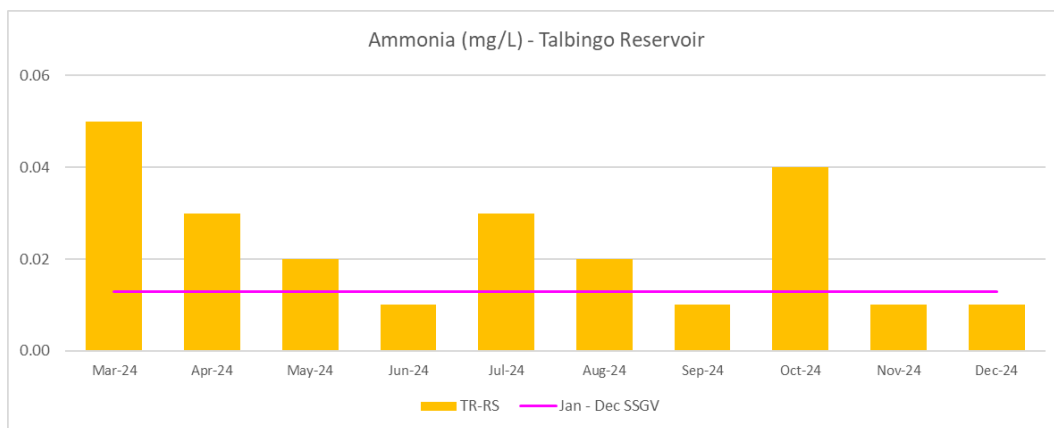


FIGURE 32: AMMONIA FOR TALBINGO RESERVOIR

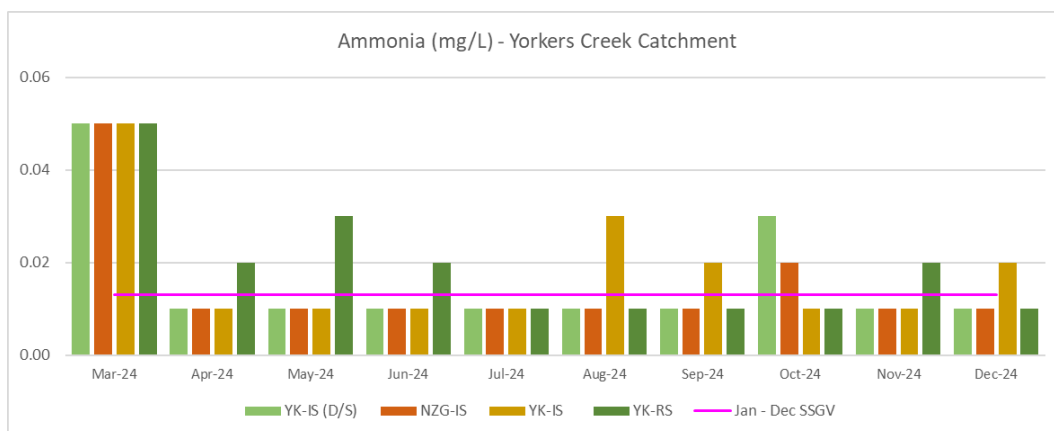


FIGURE 33: AMMONIA FOR YORKERS CREEK CATCHMENT



## Cyanide

Cyanide (mg/L) was below either the LOR at all sites, refer Figure 34 to Figure 36.

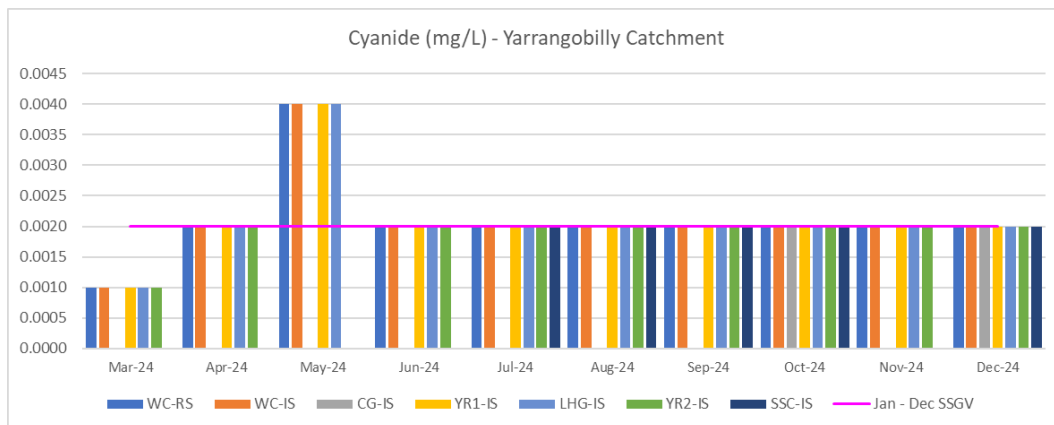


FIGURE 34: CYANIDE FOR YARRANGOBILLY RIVER CATCHMENT

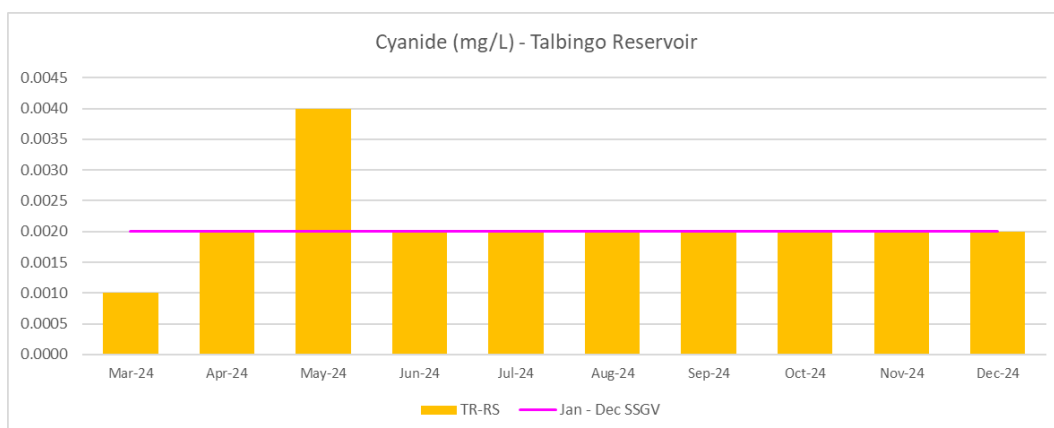


FIGURE 35: CYANIDE FOR TALBINGO RESERVOIR

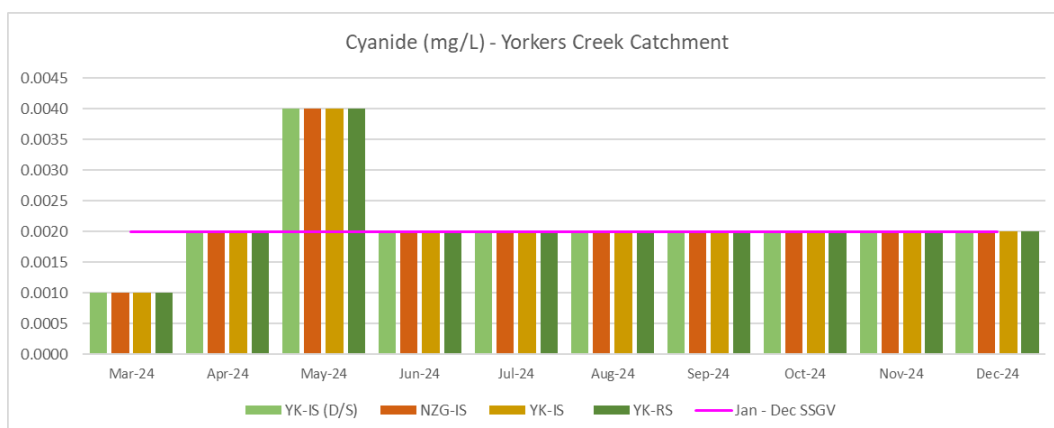


FIGURE 36: CYANIDE FOR YORKERS CREEK CATCHMENT

## Total Hardness

Within the Yarrangobilly River catchment,  $\text{CaCO}_3$  (mg/L) levels exceeded the December to May SSGV (47 mg/L) at CG-IS, LHG-IS and SSC-IS, refer to Figure 37. CG-IS and LHG-IS recorded significantly elevated values of 287 mg/L and 264 mg/L respectively. However, these values were lower than the October and November monitoring events. In comparison, SSC-IS only measured 53 mg/L. Similarly, Talbingo Reservoir exceeded the December to May SSGV (7.5 mg/L) by almost double, refer to Figure 38. In the Yorkers Creek catchment,  $\text{CaCO}_3$  values ranged from nine to 21 mg/L, all above the December to May SSGV of 1 mg/L, refer to Figure 39.

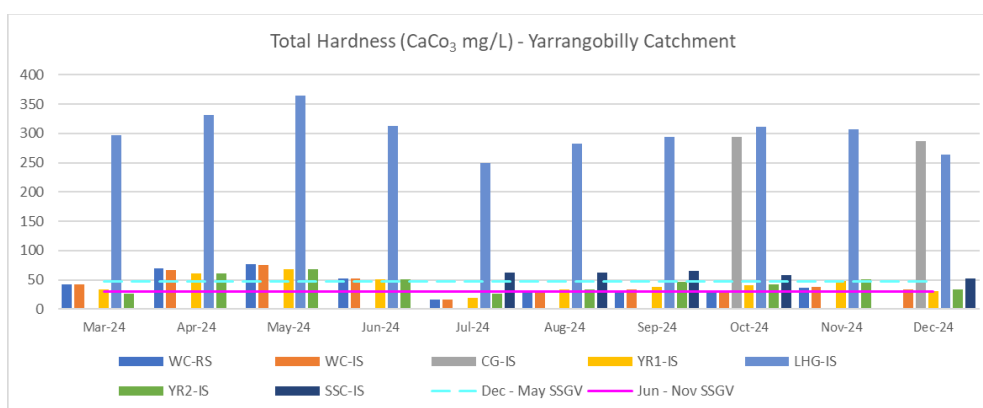


FIGURE 37:  $\text{CaCO}_3$  FOR YARRANGOBILLY RIVER CATCHMENT

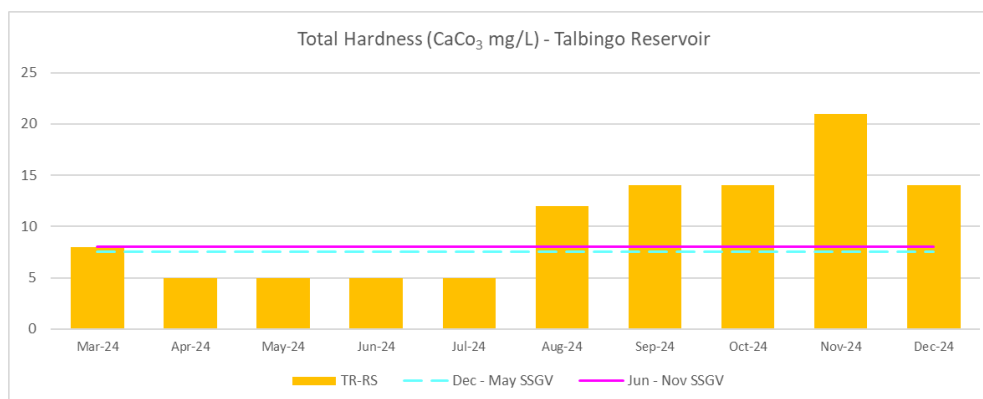


FIGURE 38:  $\text{CaCO}_3$  FOR TALBINGO RESERVOIR

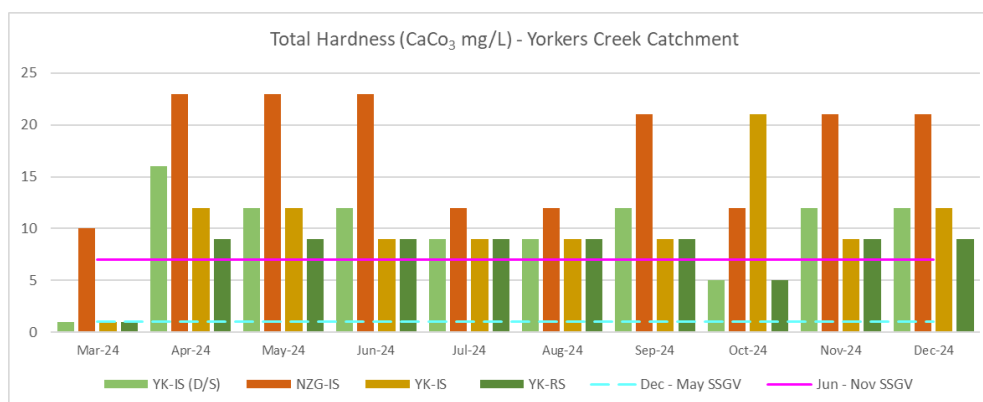


FIGURE 39:  $\text{CaCO}_3$  FOR YORKERS CREEK CATCHMENT

## Total Kjeldahl Nitrogen

TKN (mg/L) was below the LOR across all Yarrangobilly sites and Talbingo Reservoir, refer to Figure 40 and Figure 41. However, TKN exceeded the December to May SSGV (0.1) at all Yorkers Creek catchment sites, refer to Figure 42. All impact sites measured 0.2 mg/L while reference site YK-RS recorded 0.3 mg/L.

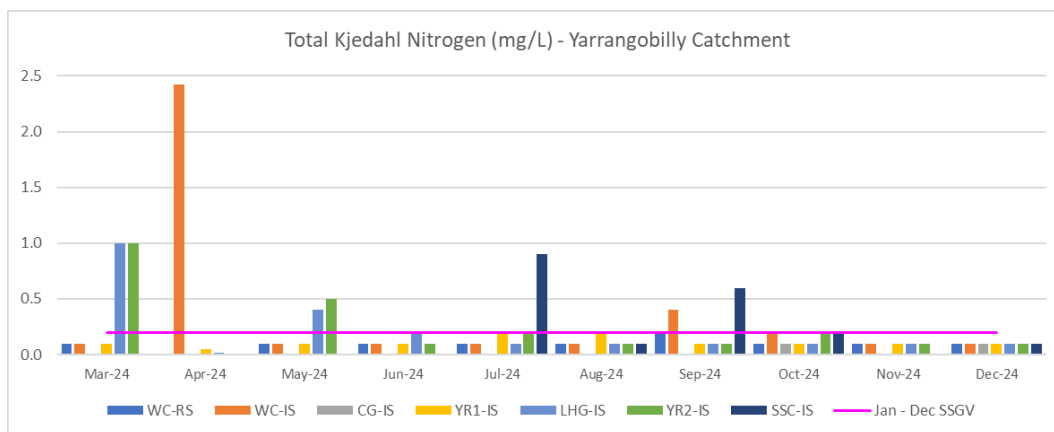


FIGURE 40: TKN FOR YARRANGOBILLY RIVER CATCHMENT

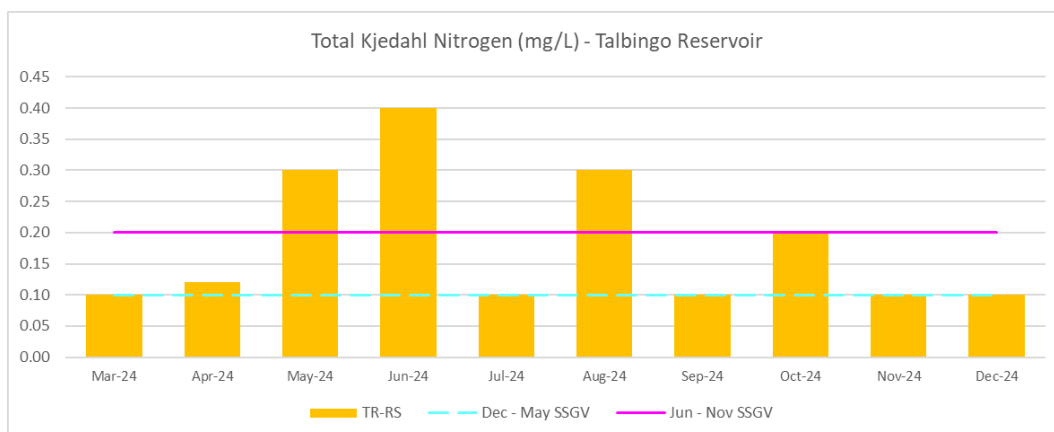


FIGURE 41: TKN FOR TALBINGO RESERVOIR

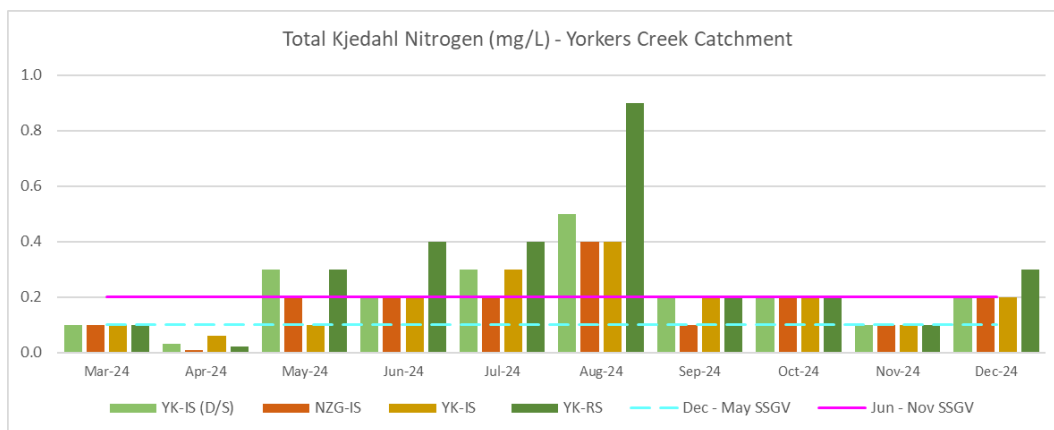


FIGURE 42: TKN FOR YORKERS CREEK CATCHMENT

## Total Nitrogen

TN (mg/L) values were below the LOR for all Yarrangobilly River catchment sites and Talbingo Reservoir, refer to Figure 43 and Figure 44. At the Yorkers Creek catchment, reference site YK-RS slightly exceeded the January to December SSGV (0.2 mg/L), measuring 0.3 mg/L. All other sites met the SSGV at 0.2 mg/L, refer to Figure 45.

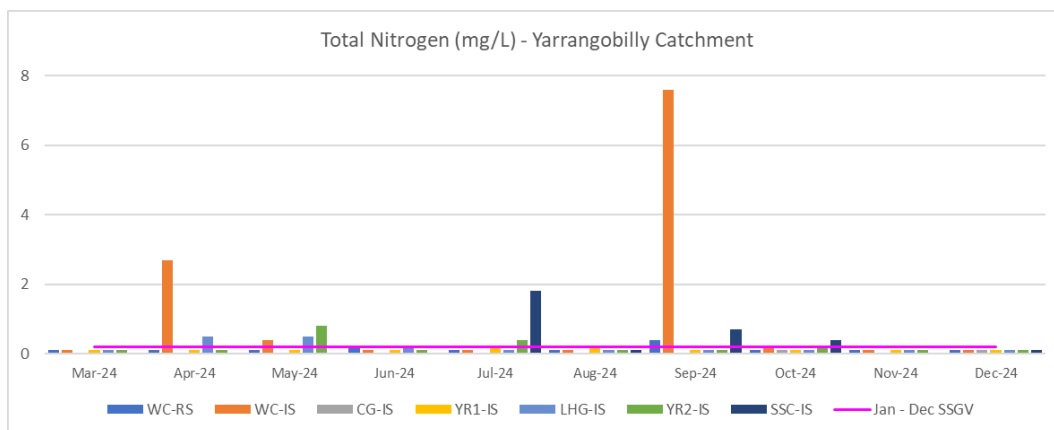


FIGURE 43: TN FOR YARRANGOBILLY RIVER CATCHMENT

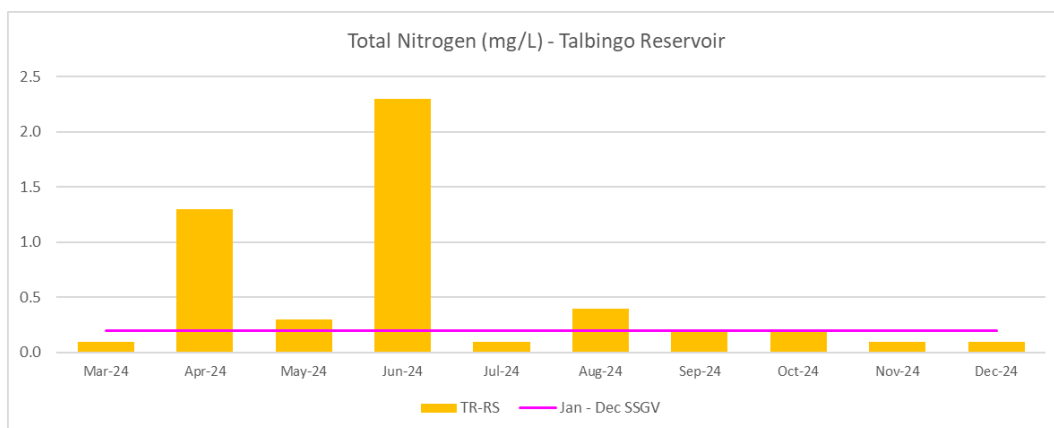


FIGURE 44: TN FOR TALBINGO RESERVOIR

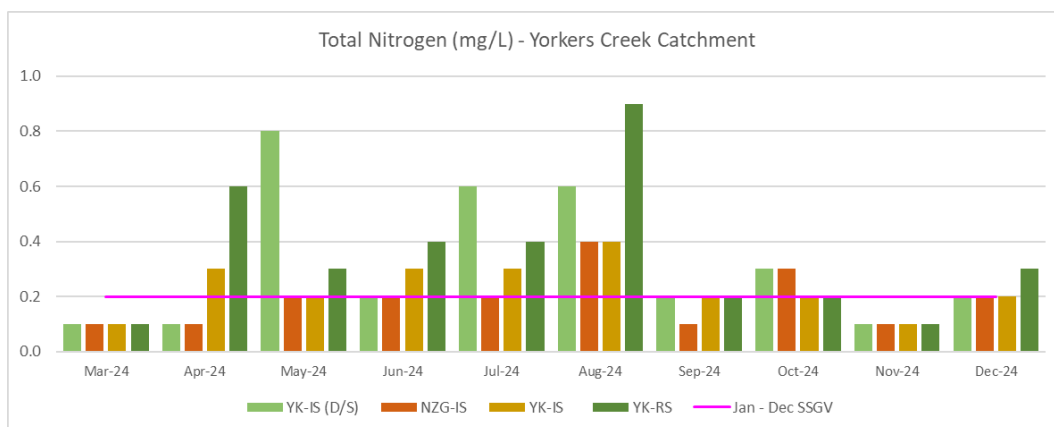


FIGURE 45: TN FOR YORKERS CREEK CATCHMENT

## Total Phosphorus

TP (mg/L) levels were either below the LOR or met the January to December SSGV (0.02 mg/L) across all Yarrangobilly River catchment sites, refer to Figure 46. Talbingo Reservoir exceeded the SSGV measuring 0.06 mg/L, refer to Figure 47. Reference site for the Yorkers Creek catchment, YK-RS, recorded double the SSGV at 0.04 mg/L while YK-IS recorded slightly above the SSGV at 0.3 mg/L. However, the other two impact sites were below the LOR, refer to Figure 48.

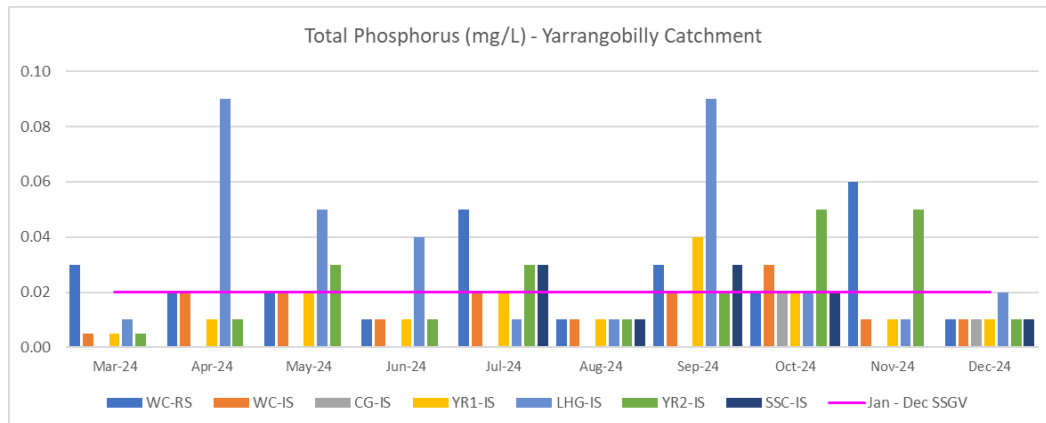


FIGURE 46: TP FOR YARRANGOBILLY RIVER CATCHMENT

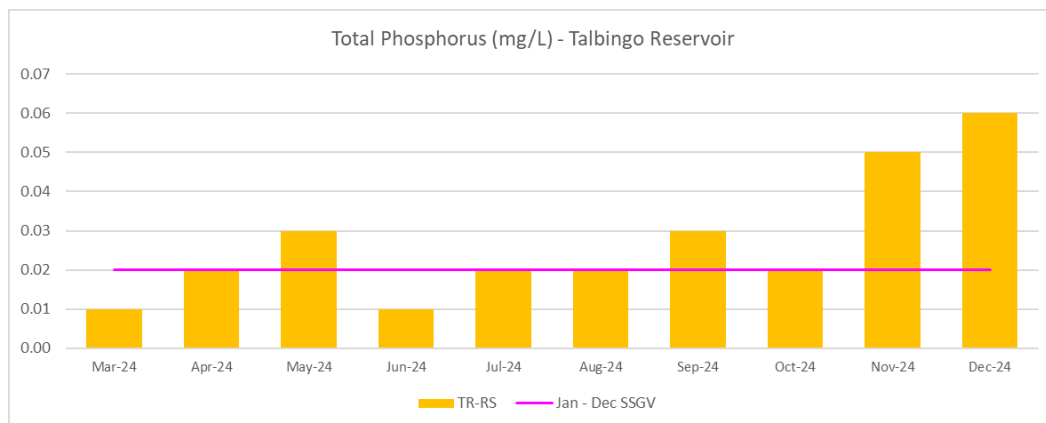


FIGURE 47: TP FOR TALBINGO RESERVOIR

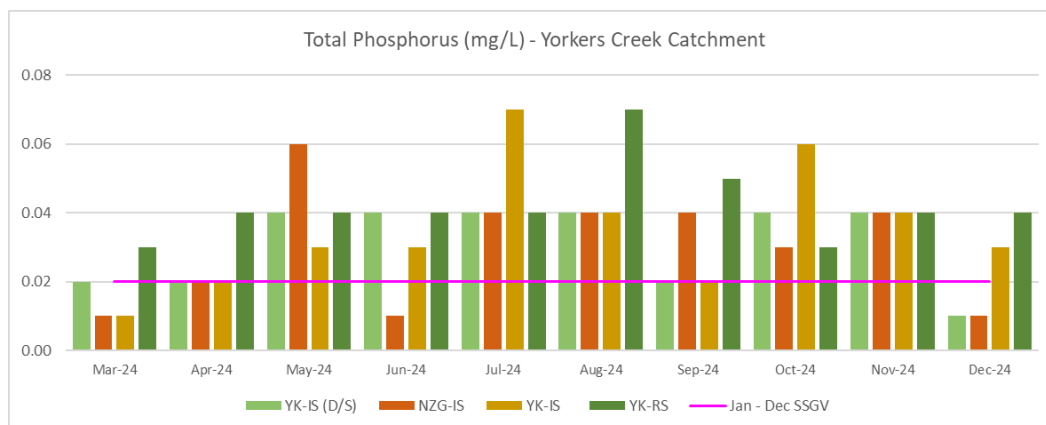


FIGURE 48: TP FOR YORKERS CREEK CATCHMENT

## Reactive Phosphorus

All sites measured below the LOR for RP (mg/L), refer to Figure 49 to Figure 51.

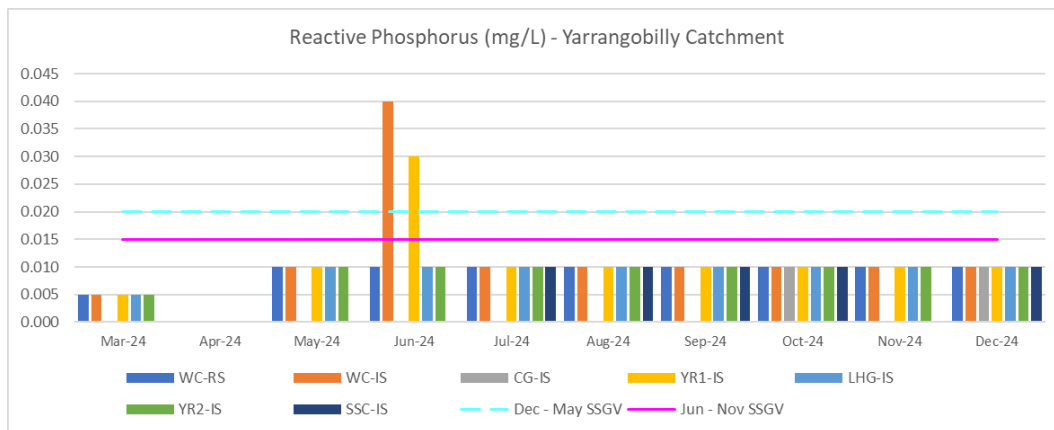


FIGURE 49: RP FOR YARRANGOBILLY RIVER CATCHMENT

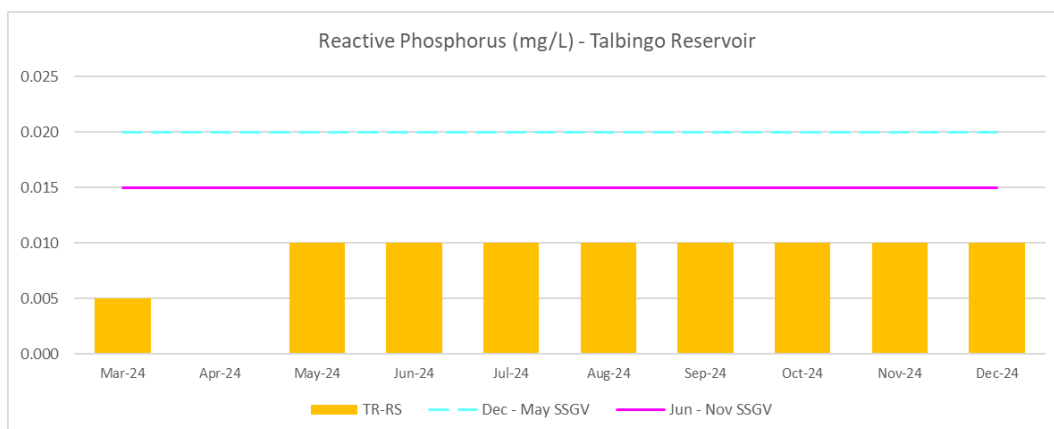


FIGURE 50: RP FOR TALBINGO RESERVOIR

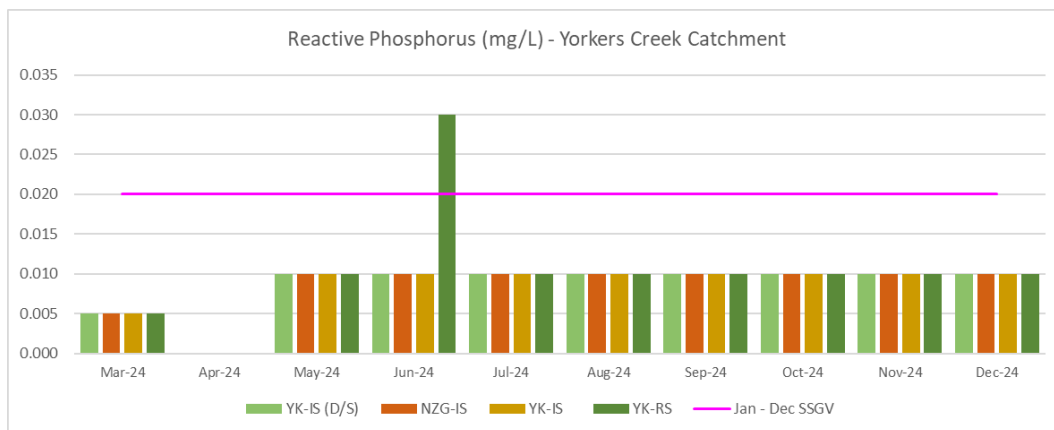


FIGURE 51: RP FOR YORKERS CREEK CATCHMENT

### 5.2.2. Dissolved Metals

Dissolved metals exceeding the relevant SSGV are listed in Table 4.

**Table 4: Results for Dissolved Metals**

DISSOLVED METALS RESULTS				
Analyte	Site	Result (mg/L)	SSGV (mg/L)	Comment
Al	YR1-IS	0.1	0.03	Only the three Yarrangobilly River catchment sites exceeded the December to May SSGV for Al (mg/L). All other sites in the catchment were below the LOR while Talbingo Reservoir and Yorkers Creek catchment sites were below the relevant SSGV.
	YR2-IS	0.09		
	SSC-IS	0.08		
Fe	YR1-IS	0.06	0.03	Fe (mg/L) levels were double the SSGV at YR1-IS and YR2-IS. All other Yarrangobilly River catchment sites and Talbingo Reservoir were below the LOR. Yorkers Creek catchment sites were all below the SSGV.
	YR2-IS	0.06		
Mn	LHG-IS	0.005	0.002	All Yarrangobilly River catchment sites were below the LOR for Mn (mg/L) except for LHG-IS. Talbingo Reservoir was also below the LOR. For Yorkers Creek catchment, YK-IS (D/S) was within the December to May SSGV and NZG-IS was below the LOR.
	YK-RS	0.024	0.005	
	YK-IS	0.017		

### 5.2.3. Total Metals

Total metals exceeding the DGV are listed in Table 5.

**Table 5: Results for Total Metals**

TOTAL METALS RESULTS				
Analyte	Site	Result (mg/L)	DGV (mg/L)	Comment
Al	WC-RS	0.09	0.027	All catchment sites exceeded the DGV for Al (mg/L) except for CG-IS which was below the LOR.
	WC-IS	0.08		
	YR1-IS	0.17		
	LHG-IS	0.13		
	YR2-IS	0.21		
	SSC-IS	0.57		
	TR-RS	0.04		
	YK-RS	0.22		
	YK-IS (D/S)	0.13		
	NZG-IS	0.09		
	YK-IS	0.59		
Fe	SSC-IS	0.41	0.3	Fe (mg/L) was within the DGV for all other Yarrangobilly River catchment sites and Talbingo Reservoir. YK-IS (D/S) and NZG-IS of the Yorkers Creek catchment also fell within the DGV.
	YK-RS	0.51		
	YK-IS	0.55		
Zn	TR-RS	0.007	0.0024	All sites within the Yarrangobilly and Yorkers Creek catchments recorded below the LOR except for YR1-IS and YK-IS (D/S) which were within the DGV for Zn (mg/L).



### 5.3. Discussion

Below is a summary of key observations and discussion points from the December monitoring results:

- Potential impacts to SWQ:
  - » Transmission line clearing and bulk earthworks activities were ongoing within the Yarrangobilly and Yorkers Creek catchment areas
  - » Impact sites within the Yarrangobilly River catchment are influenced by other activities associated with the Snowy 2.0
  - » TR-RS is located in O'Hares Campground, a popular public recreational area for water based activities including boating. It is also located adjacent to ancillary infrastructure associated with Talbingo Reservoir
  - » Hoof marks, fauna scats and aquatic fauna indicate presence of fauna in and around waterways increasing potential for erosion of banks and sedimentation into waterways
  - » Vegetative debris and materials in the water have potential to leach nutrients into waterways
  - » Existing eroded banks increase potential for sedimentation into waterways
  - » Historic metal pipe adjacent to CG-IS has potential to leach metals into waterway
  - » Waterways with shallow water depth are more prone to SWQ impacts due to lack of volume
  - » Overhanging vegetation have potential to fall into waterways and influence water parameters
  - » Vegetation cover along the riparian zone can influence the stability of the banks and groundwater which in turn may influence the waterways
  - » Sheen from organic decomposition observed on the surface of the water at WC-RS suggest potential impacts to the Yarrangobilly River catchment impact sites
  - » The Cabramurra region experienced a major rainfall event, approximately, 85 mm, between 5 to 7 December which may have impacted the waterways prior to sampling on 10 December 2024
- Sampling and analysis:
  - » Many of the results were recorded as below (<) the LOR
  - » Analysis of some parameters was inconclusive as the SSGV for a number of parameters was lower than the LOR from the laboratory
  - » Shallow water depth at sampling sites increase difficulty of sampling without disturbing bed
- SWQ parameters:
  - » Since March 2024, sites at the Yarrangobilly River catchment, including the reference site WC-RS, have consistently exceeded the relevant SSGV for the following parameters: CaCO<sub>3</sub>, TDS and TSS
  - » LHG-IS has consistently recorded higher values across multiple parameters. This could be influenced by the shallow depth of the water and the high silt deposits observed in the bed
  - » Since March 2024, CG-IS has only flowed twice during sampling, therefore, there is insufficient data to compare the results

- » Turbidity in December 2024 was significantly higher than the November monitoring period across the all catchments
- » Since March 2024, Talbingo Reservoir has consistently exceeded the relevant SSGV for the following parameters: SPC, dissolved Mn, ammonia, nitrogen oxides,  $\text{CaCO}_3$ , TDS, TSS and total Al
- » Since March 2024, sites at the Yorkers Creek catchment, including the reference site YK-RS, have consistently exceeded the relevant SSGV for the following parameters: DO, dissolved Mn, TP, nitrogen oxides,  $\text{CaCO}_3$ , TDS, TSS, Total Al and Total Fe
- » Presence of aquatic fauna at YK-RS and NZG-IS indicate the SWQ at these waterways is sufficient to support aquatic ecosystems
- » Presence of algae (not overgrown) and aquatic vegetation in waterways indicate the SWQ is sufficient to support aquatic ecosystems
- » December 2024 is the first sampling month since March that YK-IS (D/S) was within the December to May SSGV for Mn and NZG-IS was below the LOR
- » Although TDS has historically exceeded the SSGV at YK-IS (D/S), the December 2024 result of 124 mg/L is significantly high compared to 48 mg/L in November and the December to May SSGV of 30 mg/L
- » Multiple parameters which were in exceedance in November were within or had a reduced exceedance of the relevant SSGV in December
- » Temperature increased across all catchments in December 2024
- » Redox and EC were not analysed in previous months, therefore, there is insufficient data to compare the results

## 6. CONCLUSION

Monthly construction SWQ monitoring was undertaken on 10 December 2024 in accordance with EPL 21753. Monitoring was completed using the revised methodology outlined in Section 3 at the 12 locations listed in Table 1.

The results from the construction SWQ monitoring program were reported for three key catchments: Yarrangobilly River, Talbingo Reservoir, and Yorkers Creek. Each catchment had a reference site, with impact sites also monitored for comparison. Key parameters such as temperature, pH, DO, SPC, EC, turbidity, TSS, redox, ammonia, nitrogen oxides, cyanide, TKN,  $\text{CaCO}_3$ , TN, TP, RP and metals (both dissolved and total) were analysed.

In December 2024, temperatures increased across all catchments, with the Yarrangobilly River catchment ranging from 12.7 °C to 18.8 °C, Talbingo Reservoir reaching 22.8 °C, and Yorkers Creek recording 17.3 °C to 22.9 °C. The increase in temperature reflects the seasonal change between spring and summer.

pH levels were slightly higher in December 2024 than November 2024 and most locations exceeded the relevant December to May SSGV. Similarly, DO (%) was below the SSGV at all sites except for TR-RS, consistent with past results.

Except for LHG-IS, all other Yarrangobilly River catchment sites were within the December to May SSGV (115  $\mu\text{S}/\text{cm}$ ) for SPC. Talbingo Reservoir and Yorkers Creek catchment recorded below their relevant SSGV, except for NZG-IS. SPC in December significantly decreased from November results, particularly at Talbingo Reservoir.

Turbidity levels were above the relevant December to May SSGV across all reference sites and majority of the impact sites. YK-IS (D/S) and NZG-IS were the only two impact sites below their December to May SSGV. Similarly, TSS levels were also above the December to May SSGV at all reference and impact sites, except for CG-IS in the Yarrangobilly River catchment and NZG-IS in the Yorkers Creek catchment. Turbidity and TSS may have been impacted by the major rainfall event which occurred between 5 to 7 December as rainfall events have the capacity to increase flow rate and mobilise sediments.

Majority of the sites were below the LOR for nitrogen oxide, ammonia, cyanide and RP. With the exception of the Yorkers Creek catchment, most TKN and TN were also below the LOR.

$\text{CaCO}_3$  exceeded the respective December to May SSGV across most sites. In particular, despite being a decrease from previous monitoring events, CG-IS and LHG-IS recorded significantly elevated values of 287 mg/L and 264 mg/L respectively.

Exceedances of the January to December SSGV for TP were recorded at Talbingo Reservoir, YK-RS and YK-IS. The results reflect a decrease at both Yarrangobilly River and Yorkers Creek catchment since November monitoring but an increase at Talbingo Reservoir.

Only three dissolved metal analytes had exceedances in December 2024 with majority of the exceedances resulting from the Yarrangobilly River catchment. However, Mn was mostly exceeded in the Yorkers Creek catchment. Out of the three total metals with exceedances, Al was exceeded in all sites except for CG-IS which is consistent with previous monitoring events since March 2024.

## REFERENCES

- ALS. (2024a). ES2440651. *Certificate of Analysis*. NSW, Australia: ALS Limited.
- ALS. (2024b). ES2440651. *QA/QC Compliance Assessment to assist with Quality Review*. NSW, Australia: ALS Limited.
- ALS. (2024c). ES2440651. *Quality Control Report*. NSW, Australia: ALS Limited.
- ANZG. (2018). *Australian and New Zealand Guidelines for Fresh and Marine Water Quality*. ACT, Australia: Australian and New Zealand Governments and Australian state and territory governments.
- DTN. (2024, December 10). *Cabramurra Weather*. Retrieved from Weatherzone:  
<https://www.weatherzone.com.au/nsw/snowy-mountains/cabramurra>
- Jacobs. (2020). *Environmental Impact Statement*. NSW: Transgrid.
- NGH. (2022). *Pre-construction Water Quality Monitoring Program and Methodology*. NSW: NGH Pty Ltd.
- NGH. (2024). *Baseline Water Quality Report*. NSW: NGH Pty Ltd.
- UGL. (2024). December 2024. *Water Quality Monitoring Field Data Sheet*. NSW, Australia: UGL Limited.



## Appendix A: Field Sheet (UGL, 2024)



## **Appendix B: COA (ALS, 2024a), QA/QC Assessment (ALS, 2024b) and QCR (ALS, 2024c)**



## Appendix C: December 2024 SWQ Monitoring Results

			Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	Dissolved Ni (mg/L)
Parameter																						
YARRANGOBILLY CATCHMENT																						
Default Guideline Value (DGV)			No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	0.008
Limit of Reporting (LOR)				-	-	-	-	-	-	-	0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
Dec - May Site Specific Guideline Value (SSGV)				90-110	9.08	115	93.2	6.5-8	79.1	0.37	0.03	0.0003	0.00002	0.00001	0.0002	0.002	0.03	0.001	0.002	0.00003	0.001	
June - Nov SSGV				90-110	10.28	88	60.85	6.5-8	98.4	5.12	0.04	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003	0.001	
WC-RS	Mar-24	No	10.7	87.5	9.72	143.6	104.3	7.80	25.9	0.1	0.02	0.00015	0.00001	0.00001	0.0001	0.002	0.001	0.03	0.002	0.003	0.00002	0.001
	Apr-24	No	10.7	94.8	-	145.6	-	8.44	-	1.05	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.11	0.001	0.007	0.0001	0.001
	May-24	No	2.1	93.8	-	155	-	8.05	-	0.39	0.01	0.001	0.0001	0.0001	0.001	0.001	0.004	0.05	0.001	0.009	0.0001	0.001
	Jun-24	No	4.7	92.9	-	126.8	-	7.51	-	0.56	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001	0.001
	Jul-24	No	6.4	91.9	-	46.6	-	6.96	-	9.24	0.07	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Aug-24	No	10.4	80.6	-	47.1	-	7.80	-	1.6	0.02	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Sep-24	No	11.7	92.0	-	43	-	7.86	-	0.5	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Oct-24	No	9.3	92.7	-	52	-	7.55	-	1.3	0.02	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Nov-24	No	12.2	90.6	9.7	82	82	7.63	235	0.6	0.02	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001	0.001
	Dec-24	Yes	12.7	90.0	10.0	41.8	71.0	7.75	250	1.4	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
WC-IS	Mar-24	No	10.7	87.1	9.68	145.9	105.9	7.83	41.9	0.1	0.03	0.00015	0.00001	0.00001	0.0001	0.002	0.001	0.03	0.002	0.003	0.00002	0.0005
	Apr-24	No	10.7	95.0	-	145.2	-	8.45	-	0.9	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.07	0.001	0.006	0.0001	0.001
	May-24	No	2.1	94.1	-	154.9	-	7.86	-	0.3	0.01	0.001	0.0001	0.0001	0.001	0.001	0.004	0.05	0.001	0.007	0.0001	0.001
	Jun-24	No	4.8	93.3	-	126.7	-	7.72	-	0.35	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001	0.001
	Jul-24	No	6.6	91.2	-	46.6	-	6.96	-	7.65	0.07	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Aug-24	No	10.5	91.5	-	45.6	-	7.83	-	5.65	0.02	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Sep-24	No	11.7	92.9	-	54.4	-	7.83	-	5.5	0.04	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001	0.001
	Oct-24	No	9.5	93.3	-	52.1	-	7.66	-	1.4	0.02	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Nov-24	No	12.2	90.4	9.9	82	82	7.63	245	0.3	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Dec-24	No	12.7	91.1	10.1	41.3	72	7.48	259	1.4	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
CG-IS	Mar-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Apr-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	May-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jun-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jul-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Aug-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Sep-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Oct-24	No	12.7	93.2	-	382.8	-	8.17	-	1	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Nov-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-24	No	14	88.5	9.7	29	480	8.12	255	2.84	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
YR1-IS	Mar-24	No	12.2	88.2	9.47	129.4	97.7	7.81	53.8	0.1	0.05	0.00015	0.00001	0.000005	0.0002	0.001	0.03	0.0005	0.002	0.000015	0.001	
	Apr-24	No	11.3	97.4	-	136.1	-	8.49	-	1.23	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	May-24	No	3.1	95.6	-	138.8	-	7.91	-	0.42	0.01	0.001	0.0001	0.0001	0.001	0.001	0.004	0.05	0.001	0.002	0.0001	0.001
	Jun-24	No	5.6	94.3	-	112.4	-	7.80	-	1.94	0.02	0.001	0.0001	0.0001	0.001	0.001	0.002	0.14	0.001	0.003	0.0001	0.001
	Jul-24	No	6.4	93.0	-	51.5	-	6.93	-	10.05	0.18	0.001	0.0001	0.0001	0.001	0.001	0.002	0.11	0.001	0.002	0.0001	0.001
	Aug-24	No	8.6	89.8	-	55.8	-	7.87	-	3.62	0.07	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Sep-24	No	13.3	93.1	-	61.4	-	7.77	-	0.79	0.04	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Oct-24	No	12.5	94.9	-	66.8	-	7.77	-	2	0.04	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Nov-24	No	15	92.2	9.7	105	105	7.69	251	0.8	0.01	0.001	0.0001	0.0001	0.001	0.001	0.002	0.05	0.001	0.020	0.0001	0.001
	Dec-24	No	14.3	91.1	9.9	40.4	69	7.52	253	3.94	0.1	0.001	0.0001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001	0.001

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting

			Sheen/ oil/ grease	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorou s (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeda hl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)	
Parameter																											
YARRANGOBILLY CATCHMENT																											
Default Guideline Value (DGV)			No	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006	
Limit of Reporting (LOR)				0.1	0.01	0.001	0.005	0.010	0.010	0.010	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Dec - May Site Specific Guideline Value (SSGV)				0.2	0.02	0.00002	0.002	0.013	0.015	0.020	47	0.2	52	0.2													
June - Nov SSGV				0.2	0.02	0.00002	0.002	0.013	0.015	0.015	30	0.2	39	1.0													
WC-RS	Mar-24	No	0.1	0.03	0.00001	0.001	0.050	0.05	0.005		42	0.1	70	0.1													
	Apr-24	No	0.1	0.02	0.001	0.005	0.010	0.01	-		70	0.01	-	1	0.02	0.001	0.0001		0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.05	0.0001
	May-24	No	0.1	0.02	0.001	0.005	0.020	0.01	0.01		77	0.1	102	5	0.01	0.001	0.0001		0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.05	0.0001
	Jun-24	No	0.2	0.01	0.001	0.005	0.010	0.23	0.01		53	0.1	81	2	0.01	0.001	0.0001		0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.05	0.0001
	Jul-24	No	0.1	0.05	0.001	0.005	0.010	0.01	0.01	0.01	17	0.1	38	8	0.09	0.001	0.0001		0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.09	0.0001
	Aug-24	No	0.1	0.01	0.001	0.032	0.010	0.01	0.01	0.01	28	0.1	51	4	0.06	0.001	0.0001		0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.07	0.0001
	Sep-24	No	0.4	0.03	0.001	0.005	0.040	0.22	0.01		31	0.2	65	3	0.04	0.001	0.0001		0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.05	0.0001
	Oct-24	No	0.1	0.02	0.001	0.005	0.010	0.02	0.01		31	0.1	46	1	0.07	0.001	0.0001		0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.1	0.0001
	Nov-24	No	0.1	0.06	0.001	0.005	0.020	0.02	0.01		36	0.1	60	2	0.01	0.001	0.0001		0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001
	Dec-24	Yes	0.1	0.01	0.001	0.005	0.010	0.01	0.01		31	0.1	51	2	0.09	0.001	0.0001		0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.08	0.0001
WC-IS	Mar-24	No	0.1	0.005	0.00001	0.001	0.050	0.05	0.005		42	0.1	88	0.1													
	Apr-24	No	2.7	0.02	0.001	0.005	0.010	2.42	-		67	2.42	-	11	0.15	0.001	0.0001		0.001	0.001	0.001	0.022	0.004	0.001	0.005	0.22	0.0001
	May-24	No	0.4	0.02	0.001	0.005	0.010	0.31	0.01		75	0.1	106	5	0.01	0.001	0.0001		0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.05	0.0001
	Jun-24	No	0.1	0.01	0.001	0.005	0.010	0.02	0.04		53	0.1	81	1	0.01	0.001	0.0001		0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.05	0.0001
	Jul-24	No	0.1	0.02	0.001	0.005	0.010	0.01	0.01		17	0.1	42	5	0.11	0.001	0.0001		0.001	0.001	0.001	0.011	0.001	0.001	0.005	0.1	0.0001
	Aug-24	No	0.1	0.01	0.001	0.006	0.010	0.03	0.01		28	0.1	45	4	0.06	0.001	0.0001		0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.06	0.0001
	Sep-24	No	7.6	0.02	0.001	0.017	0.010	7.21	0.01		33	0.4	113	3	0.02	0.001	0.0001		0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001
	Oct-24	No	0.2	0.03	0.001	0.005	0.010	0.02	0.01		31	0.2	39	2	0.08	0.001	0.0001		0.001	0.001	0.001	0.004	0.005	0.001	0.005	0.12	0.0001
	Nov-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01		38	0.1	58	1	0.02	0.001	0.0001		0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001
	Dec-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01		33	0.1	51	2	0.08	0.001	0.0001		0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.09	0.0001
CG-IS	Mar-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Apr-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	May-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Jun-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Jul-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Aug-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Sep-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Oct-24	No	0.1	0.02	0.001	0.005	0.010	0.01	0.01		294	0.1	298	1	0.01	0.001	0.0001		0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Nov-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
YR1-IS	Dec-24	No	0.1	0.01	0.001	0.005	0.010	0.02	0.01		287	0.1	336	1	0.01	0.001	0.0001		0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
	Mar-24	No	0.1	0.005	0.00001	0.001	0.050	0.05	0.005		34	0.1	66	0.1													
	Apr-24	No	0.1	0.01	0.001	0.005	0.010	0.05	-		61	0.05	-	1	0.01	0.001	0.0001		0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001
	May-24	No	0.1	0.02	0.001	0.005	0.010	0.01	0.01		68	0.1	95	5	0.01	0.001	0.0001		0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
	Jun-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.03		51	0.1	68	1	0.03	0.001	0.0001		0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
	Jul-24	No	0.2	0.02	0.001	0.005	0.010	0.01	0.01	0.01	19	0.2	48	7	0.17	0.001	0.0001		0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.15	0.0001
	Aug-24	No	0.2	0.01	0.001	0.005	0.010	0.01	0.01	0.01	33	0.2	55	3	0.12	0.001	0.0001		0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.09	0.0001
	Sep-24	No	0.1	0.04	0.001	0.005	0.010	0.02	0.01	0.01	38	0.1	68	2	0.06	0.001	0.0001		0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001
	Oct-24	No	0.1	0.02	0.001	0.006	0.020	0.01	0.01	0.01	41	0.1	60	2	0.08	0.001	0.0001		0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.09	0.0001
	Nov-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01	0.01	48	0.1	74	1	0.04	0.001	0.0001		0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001
Dec-24	No	0.1	0.01	0.001	0.005	0.010	0.02	0.01	0.01	31	0.1	52	4	0.17	0.001	0.0001		0.001	0.001	0.001	0.006	0.001	0.001	0.001	0.039	0.15	0.0001

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting

Parameter			Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	Dissolved Ni (mg/L)
<b>YARRANGOBILLY CATCHMENT</b>																						
Default Guideline Value (DGV)			No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	0.008
Limit of Reporting (LOR)				-	-	-	-	-	-	-	0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
Dec - May Site Specific Guideline Value (SSGV)					90-110	9.08	115	93.2	6.5-8	79.1	0.37	0.03	0.0003	0.00002	0.00001	0.0002	0.002	0.03	0.001	0.002	0.00003	0.001
June - Nov SSGV					90-110	10.28	88	60.85	6.5-8	98.4	5.12	0.04	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003	0.001
LHG-IS	Mar-24	Yes		11.9	59.2	6.38	596	447.2	7.35	-17.2	408.5	0.2	0.00015	0.00001	0.001	0.003	0.001	0.18	0.005	0.040	0.000015	0.003
	Apr-24	No		12.5	60.1	-	658	-	7.69	-	69.72	0.01	0.001	0.0001	0.001	0.001	0.002	0.34	0.001	0.184	0.0001	0.001
	May-24	No		7	63.3	-	618	-	7.00	-	1003.7	0.01	0.001	0.0001	0.001	0.001	0.004	0.71	0.001	0.184	0.0001	0.001
	Jun-24	No		8.5	70.4	-	616	-	7.65	-	10.05	0.01	0.001	0.0001	0.001	0.001	0.002	0.48	0.001	0.158	0.0001	0.001
	Jul-24	No		8	87.5	-	503	-	7.30	-	5.44	0.01	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.025	0.0001	0.001
	Aug-24	No		11.4	83.0	-	408.8	-	7.74	-	76.59	0.01	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.020	0.0001	0.001
	Sep-24	No		9.7	87.3	-	424.6	-	7.68	-	6.13	0.01	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.045	0.0001	0.001
	Oct-24	No		12.4	86.5	-	432.4	-	7.59	-	2.2	0.01	0.001	0.0001	0.001	0.001	0.002	0.10	0.001	0.036	0.0001	0.001
	Nov-24	No		12.1	83.1	9.9	537	537	7.91	254	3.6	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Dec-24	No		17.6	87.4	9.4	278.1	473	8.24	252	6.7	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001	0.001
YR2-IS	Mar-24	No		12.3	88.5	9.47	130.8	99.1	7.93	43.2	0.1	0.03	0.00015	0.00001	0.000005	0.001	0.001	0.02	0.005	0.001	0.000015	0.001
	Apr-24	No		11.8	97.1	-	139.7	-	8.52	-	1.16	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001	0.001
	May-24	No		2.5	94.7	-	142.1	-	7.77	-	0.343	0.01	0.001	0.0001	0.001	0.001	0.024	0.05	0.001	0.004	0.0001	0.001
	Jun-24	No		4.7	97.1	-	118.6	-	7.24	-	0	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001	0.001
	Jul-24	No		5.9	93.5	-	58.4	-	6.78	-	8.87	0.17	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.002	0.0001	0.001
	Aug-24	No		9.3	93.5	-	58.5	-	7.98	-	6.97	0.06	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Sep-24	No		13.4	93.8	-	66.7	-	7.62	-	1.56	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001	0.001
	Oct-24	No		11.6	93.7	-	69.9	-	7.34	-	1.8	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Nov-24	No		15.7	92.1	10	62	111	7.92	235	0.6	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Dec-24	No		13.6	90.3	9.8	44.1	75	7.84	220	5.64	0.09	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001	0.001
SSC-IS	Mar-24	No Flow		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Apr-24	No Flow		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	May-24	No Flow		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jun-24	No Flow		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jul-24	No		8	90.1	-	152.6	-	6.29	-	17.88	0.1	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.002	0.0001	0.001
	Aug-24	No		12.1	94.0	-	120.9	-	7.78	-	3.9	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Sep-24	No		12.2	84.1	-	122.2	-	7.10	-	3.53	0.05	0.001	0.0001	0.001	0.003	0.002	0.05	0.001	0.002	0.0001	0.001
	Oct-24	No		10.1	81.5	-	110.3	-	6.83	-	8.9	0.08	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Nov-24	No Flow		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-24	No		18.8	90.7	9.4	68.5	118	7.97	188	44.29	0.08	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting

Sheen/ oil/ grease			TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorou s (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeda hl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)	
Parameter																										
YARRANGOBILLY CATCHMENT																										
Default Guideline Value (DGV)			No	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006
Limit of Reporting (LOR)				0.1	0.01	0.001	0.005	0.010	0.010	0.010	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Dec - May Site Specific Guideline Value (SSGV)				0.2	0.02	0.00002	0.002	0.013	0.015	0.020	47	0.2	52	0.2												
June - Nov SSGV				0.2	0.02	0.00002	0.002	0.013	0.015	0.015	30	0.2	39	1.0												
LHG-IS	Mar-24	Yes	0.1	0.01	0.00001	0.006	0.050	0.05	0.005	297	1	330	20													
	Apr-24	No	0.5	0.09	0.001	0.005	0.020	0.02	-	332	0.02	-	70	0.25	0.003	0.0001	0.001	0.002	0.001	0.51	0.006	0.001	0.009	2.22	0.0001	
	May-24	No	0.5	0.05	0.001	0.005	0.040	0.06	0.01	365	0.4	402	5	0.07	0.001	0.0001	0.001	0.001	0.001	0.177	0.001	0.001	0.005	1.09	0.0001	
	Jun-24	No	0.2	0.04	0.001	0.005	0.020	0.02	0.01	313	0.2	339	17	0.38	0.002	0.0001	0.001	0.001	0.001	0.282	0.001	0.001	0.005	1.54	0.0001	
	Jul-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01	250	0.1	324	10	0.53	0.001	0.0001	0.001	0.002	0.001	0.033	0.001	0.001	0.005	0.16	0.0001	
	Aug-24	No	0.1	0.01	0.001	0.006	0.020	0.01	0.01	282	0.1	360	9	0.09	0.001	0.0001	0.001	0.001	0.001	0.026	0.001	0.001	0.005	0.17	0.0001	
	Sep-24	No	0.1	0.09	0.001	0.006	0.010	0.01	0.01	294	0.1	394	10	0.06	0.001	0.0001	0.001	0.001	0.001	0.051	0.001	0.001	0.005	0.19	0.0001	
	Oct-24	No	0.1	0.02	0.001	0.005	0.020	0.01	0.01	312	0.1	362	3	0.04	0.001	0.0001	0.001	0.001	0.001	0.034	0.001	0.001	0.005	0.26	0.0001	
	Nov-24	No	0.1	0.01	0.001	0.005	0.100	0.01	0.01	307	0.1	363	16	0.15	0.001	0.0001	0.001	0.001	0.001	0.023	0.001	0.001	0.005	0.21	0.0001	
	Dec-24	No	0.1	0.02	0.001	0.005	0.010	0.01	0.01	264	0.1	298	7	0.13	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.12	0.0001	
YR2-IS	Mar-24	No	0.1	0.005	0.00001	0.001	0.050	0.05	0.005	27	1	58	0.1													
	Apr-24	No	0.1	0.01	0.001	0.005	0.010	0.01	-	61	0.01	-	5	0.02	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
	May-24	No	0.8	0.03	0.001	0.007	0.020	0.34	0.01	68	0.5	98	5	0.01	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.007	0.05	0.0001	
	Jun-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01	51	0.1	76	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001	
	Jul-24	No	0.4	0.03	0.001	0.005	0.010	0.24	0.01	26	0.2	46	10	0.17	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.007	0.16	0.0001	
	Aug-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01	33	0.1	59	4	0.11	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.09	0.0001	
	Sep-24	No	0.1	0.02	0.001	0.005	0.010	0.01	0.01	46	0.1	68	3	0.07	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.07	0.0001	
	Oct-24	No	0.2	0.05	0.001	0.005	0.010	0.01	0.01	43	0.2	71	1	0.07	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.08	0.0001	
	Nov-24	No	0.1	0.05	0.001	0.005	0.010	0.02	0.01	51	0.1	77	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.05	0.0001	
	Dec-24	No	0.1	0.01	0.001	0.005	0.020	0.08	0.01	33	0.1	55	6	0.21	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.18	0.0001	
SSC-IS	Mar-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Apr-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	May-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Jun-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Jul-24	No	1.8	0.03	0.001	0.024	0.030	0.85	0.01	62	0.9	110	1	0.09	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.025	0.4	0.0001	
	Aug-24	No	0.1	0.01	0.001	0.005	0.010	0.01	0.01	62	0.1	110	5	0.21	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.09	0.0001	
	Sep-24	No	0.7	0.03	0.001	0.036	0.010	0.07	0.01	65	0.6	108	5	0.10	0.001	0.0001	0.001	0.003	0.001	0.004	0.001	0.001	0.028	0.08	0.0001	
	Oct-24	No	0.4	0.02	0.001	0.005	0.010	0.18	0.01	58	0.2	100	1	0.13	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.1	0.0001	
	Nov-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Dec-24	No	0.1	0.01	0.001	0.005	0.01	0.01	0.01	53	0.1	85	8	0.57	0.001	0.0001	0.001	0.001	0.001	0.013	0.001	0.001	0.005	0.41	0.0001	

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting

Parameter		Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	Dissolved Ni (mg/L)
TALBINGO RESERVOIR																					
DGV		No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	0.008
LOR				-	-	-	-	-	-	0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
Dec - May SSGV				90-100	8.79	24.0	20.3	6.5-8	91.2	0.09	0.03	0.003	0.00002	0.00001	0.0002	0.002	0.04	0.001	0.003	0.00003	0.001
June - Nov SSGV				90-100	11.53	38.7	26.2	6.5-8	95.4	1.56	0.015	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003	0.001
TR-RS	Mar-24	No	13.4	72.5	7.57	24	18.7	7.10	55	0.10	0.015	0.00015	0.00001	0.000005	0.0001	0.001	0.05	0.005	0.005	0.000015	0.0005
	Apr-24	No	12.2	85.9	-	25.9	-	7.17	-	0.02	0.01	0.001	0.0001	0.001	0.005	0.002	0.05	0.001	0.026	0.0001	0.001
	May-24	No	10.1	91.5	-	30.2	-	6.80	-	0.65	0.01	0.001	0.0001	0.001	0.001	0.004	0.05	0.001	0.002	0.0001	0.001
	Jun-24	No	8.7	91.6	-	26.4	-	8.32	-	0.10	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.010	0.0001	0.001
	Jul-24	No	6	92.1	-	28.7	-	7.76	-	1.35	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001	0.001
	Aug-24	No	12.7	91.5	-	26.3	-	6.67	-	2.0	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Sep-24	No	10.2	96.2	-	25	-	7.78	-	0.58	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	0.001
	Oct-24	No	9.5	95.2	-	15.3	-	7.78	-	1.7	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001	0.001
	Nov-24	No	15.6	92.1	9.7	55	55	7.73	271	1.6	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.05	0.0001	0.001
	Dec-24	No	22.8	95.5	9.1	22.2	38	7.97	200	3.76	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
	Jan-25																				

Parameter		TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorous (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjedadhl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)	
TALBINGO RESERVOIR																									
DGV		0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006	
LOR		0.1	0.01	0.001	0.005	0.010	0.010	0.01	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Dec - May SSGV		0.2	0.02	0.00002	0.002	0.013	0.015	0.02	7.5	0.1	12.5	0.2													
June - Nov SSGV		0.2	0.02	0.00002	0.002	0.013	0.015	0.015	8	0.2	15	0.2													
TR-RS	Mar-24	0.1	0.01	0.00001	0.001	0.050	0.05	0.005	8	0.1	44	0.1													
	Apr-24	1.3	0.02	0.001	0.066	0.030	0.12	-	5	0.12	-	3	0.02	0.001	0.0001	0.001	0.006	0.001	0.039	0.002	0.001	0.067	0.07	0.0001	
	May-24	0.3	0.03	0.001	0.023	0.020	0.03	0.01	5	0.3	35	5	0.03	0.001	0.0001	0.001	0.001	0.001	0.033	0.001	0.001	0.012	0.06	0.0001	
	Jun-24	2.3	0.01	0.001	0.005	0.010	1.92	0.01	5	0.4	17	2	0.03	0.001	0.0001	0.001	0.001	0.001	0.056	0.001	0.001	0.005	0.07	0.0001	
	Jul-24	0.1	0.02	0.001	0.005	0.030	0.04	0.01	5	0.1	17	2	0.05	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.06	0.0001	
	Aug-24	0.4	0.02	0.001	0.011	0.020	0.07	0.01	12	0.3	30	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.008	0.05	0.0001	
	Sep-24	0.2	0.03	0.001	0.005	0.010	0.06	0.01	14	0.1	27	2	0.06	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.07	0.0001	
	Oct-24	0.2	0.02	0.001	0.013	0.040	0.02	0.01	14	0.2	38	4	0.07	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.11	0.0001	
	Nov-24	0.1	0.05	0.001	0.005	0.010	0.02	0.01	21	0.1	45	5	0.14	0.001	0.0001	0.001	0.001	0.001	0.07	0.001	0.001	0.005	0.23	0.0001	
	Dec-24	0.1	0.06	0.001	0.005	0.010	0.01	0.01	14	0.1	25	2	0.04	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.007	0.06	0.0001	

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting



Parameter		Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	Dissolved Ni (mg/L)
YORKERS CREEK CATCHMENT																					
DGV		No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	0.008
LOR		-	-	-	-	-	-	-	-	0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	0.001
Dec - May SSGV				90-110	8.35	31	24	6.5-8	94.6	9	0.36	0.003	0.00002	0.00001	0.002	0.002	0.41	0.001	0.005	0.00003	0.001
June - Nov SSGV				90-110	10.2	27.9	20.5	6.5-8	106.1	7.87	0.32	0.0003	0.00002	0.00001	0.0002	0.002	0.23	0.001	0.003	0.00003	0.001
YK-RS	Mar-24	Yes	16.3	82.5	8.09	31.5	26.2	6.69	64.5	12.24	0.6	0.00015	0.00001	0.000005	0.001	0.001	0.66	0.002	0.013	0.000015	0.0005
	Apr-24	No	6.8	80.7	-	36.5	-	7.04	-	17.27	0.10	-	0.0001	0.001	0.001	0.002	0.12	0.001	0.014	0.0001	0.001
	May-24	No	4.2	85.1	-	34.7	-	6.62	-	0.3	0.10	0.001	0.0001	0.001	0.001	0.004	0.17	0.001	0.026	0.0001	0.001
	Jun-24	No	3.5	84.2	-	30.1	-	7.99	-	26.48	0.09	0.001	0.0001	0.001	0.001	0.002	0.18	0.001	0.021	0.0001	0.001
	Jul-24	No	2.9	83.1	-	27.8	-	7.40	-	7.97	0.19	0.001	0.0001	0.001	0.001	0.002	0.21	0.001	0.010	0.0001	0.001
	Aug-24	No	7.3	82.7	-	21.6	-	6.89	-	19.36	0.33	0.001	0.0001	0.001	0.001	0.002	0.29	0.001	0.017	0.0001	0.001
	Sep-24	No	12.3	86.5	-	19.5	-	7.58	-	15.51	0.09	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.013	0.0001	0.001
	Oct-24	No	18.3	87.8	-	21.8	-	7.55	-	17.9	0.14	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.013	0.0001	0.001
	Nov-24	No	19.3	84.8	9	30	30	6.68	259	13.8	0.06	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.014	0.0001	0.001
	Dec-24	No	22.9	82.6	8.3	18.7	31	7.52	238	19	0.13	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.024	0.0001	0.001
YK-IS (D/S)	Mar-24	No	10	81.6	9.21	39.1	27.9	7.02	63.2	0.1	0.0065	0.00015	0.00001	0.000005	0.0001	0.001	0.26	0.0005	0.006	0.000015	0.0005
	Apr-24	No	5.9	86.0	-	39.4	-	7.33	-	221.78	0.05	0.001	0.0001	0.001	0.001	0.002	0.11	0.001	0.014	0.0001	0.001
	May-24	No	3.1	85.9	-	39.6	-	6.59	-	0.8	0.09	0.001	0.0001	0.001	0.001	0.004	0.15	0.001	0.021	0.0001	0.001
	Jun-24	No	3.2	84.6	-	38.9	-	7.76	-	2.46	0.06	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.009	0.0001	0.001
	Jul-24	No	3.2	85.0	-	32.8	-	7.11	-	8.29	0.28	0.001	0.0001	0.001	0.001	0.002	0.22	0.001	0.005	0.0001	0.001
	Aug-24	No	7.3	84.7	-	23.2	-	6.85	-	22.38	0.51	0.001	0.0001	0.001	0.001	0.002	0.34	0.001	0.011	0.0001	0.001
	Sep-24	No	9.3	84.5	-	26.9	-	7.52	-	3.34	0.07	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.006	0.0001	0.001
	Oct-24	No	11.3	84.0	-	27	-	7.36	-	6.4	0.1	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.010	0.0001	0.001
	Nov-24	No	13.5	83.3	9.4	38	38	7.17	268	5.5	0.05	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.011	0.0001	0.001
	Dec-24	No	17.7	82.9	9.2	22.2	550	7.03	463	6.27	0.07	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.004	0.0001	0.001
NZG-IS	Mar-24	No	9.6	80.2	9.13	64.2	45.3	7.45	31.1	0.1	0.14	0.00015	0.00001	0.000005	0.0001	0.001	0.18	0.0005	0.004	0.000015	0.0005
	Apr-24	No	6.4	84.9	-	67.1	-	7.38	-	0.96	0.03	-	0.0001	0.001	0.001	0.002	0.08	0.001	0.006	0.0001	0.001
	May-24	No	3.9	85.8	-	66.6	-	6.68	-	0.2	0.04	0.001	0.0001	0.001	0.001	0.004	0.07	0.001	0.007	0.0001	0.001
	Jun-24	No	4.4	82.7	-	64.1	-	8.14	-	0.89	0.04	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.005	0.0001	0.001
	Jul-24	No	3.7	83.9	-	34.8	-	7.44	-	13.66	0.2	0.001	0.0001	0.001	0.001	0.002	0.18	0.001	0.004	0.0001	0.001
	Aug-24	No	7.7	84.4	-	28.9	-	6.95	-	15.47	0.44	0.001	0.0001	0.001	0.001	0.002	0.31	0.001	0.008	0.0001	0.001
	Sep-24	No	8.2	84.6	-	38.2	-	7.32	-	2.02	0.06	0.001	0.0001	0.001	0.001	0.002	0.08	0.001	0.004	0.0001	0.001
	Oct-24	No	11.1	84.5	-	39.6	-	7.47	-	5.3	0.08	0.001	0.0001	0.001	0.001	0.002	0.11	0.001	0.008	0.0001	0.001
	Nov-24	No	12.4	82.2	9.6	32.4	57	7.29	276	1.4	0.04	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.005	0.0001	0.001
	Dec-24	No	17.3	84.8	9.2	32.8	52	7.30	304	3.79	0.04	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001	0.001
YK-IS	Mar-24	No	11.4	78.0	8.53	35	25.9	6.70	41.1	21.44	0.45	0.00015	0.00001	0.000005	0.001	0.001	0.4	0.0005	0.018	0.000015	0.0005
	Apr-24	No	6.8	80.7	-	36.5	-	7.04	-	12.37	0.09	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.016	0.0001	0.001
	May-24	No	4.7	82.7	-	35.8	-	6.43	-	0.2	0.06	0.001	0.0001	0.001	0.001	0.004	0.1	0.001	0.015	0.0001	0.001
	Jun-24	No	3.9	83.1	-	35.1	-	7.88	-	7.99	0.08	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.010	0.0001	0.001
	Jul-24	No	3.2	82.8	-	32.5	-	7.00	-	11.9	0.31	0.001	0.0001	0.001	0.001	0.002	0.25	0.001	0.008	0.0001	0.001
	Aug-24	No	7.2	81.3	-	23.5	-	6.70	-	25.12	0.67	0.001	0.0001	0.001	0.001	0.002	0.46	0.001	0.015	0.0001	0.002
	Sep-24	No	9.3	83.4	-	23.8	-	7.41	-	6.24	0.09	0.001	0.0001	0.001	0.001	0.002	0.13	0.001	0.009	0.0001	0.001
	Oct-24	No	13.7	86.3	-	23.7	-	7.83	-	3.1	0.07	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.004	0.0001	0.001
	Nov-24	No	14.7	83.3	9.3	27.7	32	7.17	279	4.6	0.06	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.016	0.0001	0.001
	Dec-24	No	18.4	80.2	8.7	21.4	35	7.15	256	10.66	0.08	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.017	0.0001	0.001

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting

Parameter		TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorous (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjedaahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)
YORKERS CREEK CATCHMENT																								
DGV		0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006
LOR		0.1	0.01	0.001	0.005	0.010	0.010	0.01	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Dec - May SSGV		0.2	0.02	0.00002	0.002	0.013	0.015	0.02	1	0.1	30	3												
June - Nov SSGV		0.2	0.02	0.00002	0.002	0.013	0.015	0.02	7	0.2	10	0.2												
YK-RS	Mar-24	0.1	0.03	0.00001	0.003	0.050	0.05	0.005	1	0.1	30	3												
	Apr-24	0.6	0.04	0.001	0.013	0.020	0.02	-	9	0.02	-	24	0.15	0.001	0.0001	0.001	0.007	0.001	0.021	0.006	0.001	0.016	0.46	0.0001
	May-24	0.3	0.04	0.001	0.005	0.030	0.02	0.01	9	0.3	37	5	0.10	0.001	0.0001	0.001	0.001	0.001	0.027	0.001	0.001	0.005	0.34	0.0001
	Jun-24	0.4	0.04	0.001	0.005	0.020	0.02	0.03	9	0.4	21	15	0.23	0.001	0.0001	0.001	0.001	0.001	0.032	0.001	0.001	0.005	0.50	0.0001
	Jul-24	0.4	0.04	0.001	0.007	0.010	0.05	0.01	9	0.4	41	7	0.59	0.001	0.0001	0.001	0.001	0.001	0.017	0.001	0.001	0.005	0.53	0.0001
	Aug-24	0.9	0.07	0.001	0.012	0.010	0.01	0.01	9	0.9	34	19	1.82	0.001	0.0001	0.003	0.001	0.001	0.076	0.001	0.001	0.005	1.77	0.0001
	Sep-24	0.2	0.05	0.001	0.010	0.010	0.04	0.01	9	0.2	28	19	0.28	0.001	0.0001	0.001	0.001	0.001	0.023	0.001	0.001	0.005	0.52	0.0001
	Oct-24	0.2	0.03	0.001	0.005	0.010	0.05	0.01	5	0.2	21	22	0.24	0.001	0.0001	0.001	0.001	0.001	0.02	0.001	0.001	0.005	0.45	0.0001
	Nov-24	0.1	0.04	0.001	0.008	0.020	0.03	0.01	9	0.1	46	30	1.29	0.001	0.0001	0.002	0.001	0.001	0.032	0.001	0.001	0.005	1.05	0.0001
	Dec-24	0.3	0.04	0.001	0.005	0.010	0.04	0.01	9	0.3	40	22	0.22	0.001	0.0001	0.001	0.001	0.001	0.031	0.001	0.001	0.005	0.51	0.0001
YK-IS (D/S)	Mar-24	0.1	0.02	0.00001	0.002	0.050	0.05	0.005	1	0.1	15	0.1												
	Apr-24	0.1	0.02	0.001	0.005	0.010	0.03	-	16	0.03	-	3	0.1	0.001	0.0001	0.001	0.001	0.001	0.016	0.003	0.001	0.006	0.26	0.0001
	May-24	0.8	0.04	0.001	0.005	0.010	0.53	0.01	12	0.3	39	9	0.12	0.001	0.0001	0.003	0.001	0.001	0.035	0.002	0.001	0.005	0.61	0.0001
	Jun-24	0.2	0.04	0.001	0.005	0.010	0.01	0.01	12	0.2	25	2	0.48	0.001	0.0001	0.001	0.001	0.001	0.027	0.001	0.001	0.005	0.66	0.0001
	Jul-24	0.6	0.04	0.001	0.007	0.010	0.28	0.01	9	0.3	52	5	0.3	0.001	0.0001	0.001	0.001	0.001	0.011	0.001	0.001	0.005	0.32	0.0001
	Aug-24	0.6	0.04	0.001	0.005	0.010	0.09	0.01	9	0.5	70	17	1.02	0.001	0.0001	0.005	0.001	0.001	0.026	0.001	0.001	0.005	0.89	0.0001
	Sep-24	0.2	0.02	0.001	0.011	0.010	0.01	0.01	12	0.2	29	3	0.16	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.005	0.26	0.0001
	Oct-24	0.3	0.04	0.001	0.009	0.030	0.11	0.01	5	0.2	24	4	0.22	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.28	0.0001
	Nov-24	0.1	0.04	0.001	0.005	0.010	0.01	0.01	12	0.1	48	8	0.26	0.001	0.0001	0.001	0.001	0.001	0.07	0.001	0.001	0.005	0.41	0.0001
	Dec-24	0.2	0.01	0.001	0.005	0.010	0.02	0.01	12	0.2	124	5	0.13	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.011	0.27	0.0001
NZG-IS	Mar-24	0.1	0.01	0.00001	0.002	0.050	0.05	0.005	10	0.1	22	0.1												
	Apr-24	0.1	0.02	0.001	0.005	0.010	0.01	-	23	0.01	-	6	0.04	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.005	0.24	0.0001
	May-24	0.2	0.06	0.001	0.007	0.010	0.03	0.01	23	0.2	60	5	0.06	0.001	0.0001	0.001	0.001	0.001	0.021	0.001	0.001	0.005	0.35	0.0001
	Jun-24	0.2	0.01	0.001	0.005	0.010	0.01	0.01	23	0.2	38	20	0.12	0.001	0.0001	0.001	0.001	0.001	0.037	0.001	0.001	0.005	0.67	0.0001
	Jul-24	0.2	0.04	0.001	0.005	0.010	0.04	0.01	12	0.2	52	8	0.22	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.26	0.0001
	Aug-24	0.4	0.04	0.001	0.005	0.010	0.01	0.01	12	0.4	44	19	0.92	0.001	0.0001	0.001	0.001	0.001	0.023	0.001	0.001	0.005	0.85	0.0001
	Sep-24	0.1	0.04	0.001	0.005	0.010	0.01	0.01	21	0.1	41	3	0.07	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.15	0.0001
	Oct-24	0.3	0.03	0.001	0.005	0.020	0.07	0.01	12	0.2	26	3	0.17	0.001	0.0001	0.001	0.001	0.001	0.01	0.002	0.001	0.005	0.27	0.0001
	Nov-24	0.1	0.04	0.001	0.005	0.010	0.01	0.01	21	0.1	60	1	0.11	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.14	0.0001
	Dec-24	0.2	0.01	0.001	0.005	0.010	0.01	0.01	21	0.2	50	1	0.09	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.16	0.0001
YK-IS	Mar-24	0.1	0.01	0.00001	0.004	0.050	0.05	0.005	1	0.1	21	1												
	Apr-24	0.3	0.02	0.001	0.005	0.010	0.06	-	12	0.06	-	13	0.15	0.001	0.0001	0.001	0.001	0.001	0.024	0.001	0.001	0.005	0.52	0.0001
	May-24	0.2	0.03	0.001	0.005	0.010	0.05	0.01	12	0.1	48	5	0.04	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.16	0.0001
	Jun-24	0.3	0.03	0.001	0.005	0.010	0.06	0.01	9	0.2	19	6	0.32	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.42	0.0001
	Jul-24	0.3	0.07	0.001	0.009	0.010	0.01	0.01	9	0.3	52	7	0.8	0.001	0.0001	0.001	0.001	0.001	0.015	0.001	0.001	0.005	0.62	0.0001
	Aug-24	0.4	0.04	0.001	0.005	0.030	0.01	0.01	9	0.4	62	15	1.22	0.001	0.0001	0.003	0.001	0.001	0.026	0.001	0.001	0.005	0.99	0.0001
	Sep-24	0.2	0.02	0.001	0.005	0.020	0.01	0.01	9	0.2	26	4	0.16	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.005	0.26	0.0001
	Oct-24	0.2	0.06	0.001	0.005	0.010	0.01	0.01	21	0.2	40	4	0.14	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.23	0.0001
	Nov-24	0.1	0.04	0.001	0.01	0.010	0.01	0.01	9	0.1	42	3	0.31	0.001	0.0001	0.001	0.001	0.001	0.022	0.001	0.001	0.005	0.39	0.0001
	Dec-24	0.2	0.03	0.001	0.005	0.020	0.02	0.01	12	0.2	40	6	0.59	0.001	0.0001	0.001	0.001	0.001	0.026	0.001	0.001	0.005	0.55	0.0001

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting



## Appendix D: Calibration Certificate